3,510.50

12.40%

Geotest Engineering, Inc.

Geotechnical Engineers and Materials Testing

5600 Bintliff Drive, Houston, TX 77036

Telephone: (713) 266-0588 (713) 266-2977

INVOICE

Name:

Fort Bend County

Invoice No. 20109 -1 - 462

Address:

Community Development Department 4520 Reading Road, Suite A

Date:

Project No. 1150224401

1-Mar-11

City, Zip:

Rosenberg, Texas 77471

Total Billed Project to date Amount Remaining in the Contract

Mary and that the first part of A. 189 (100 - 100 - 3 1998 B. Artist Constitution

CANDERSON CONTRACTOR SECRET

Percent Complete

Ms. Karen A. Bringol

Attention: Reference:

Material Testing for Kendleton Wastewater Treatment Plant

Fee Code: 2244

for Fort Bend County

Authorization: Purchase Order No. 58428

TERMS: NET 10 DAYS

| Date | Req | Report No(s). | Services Provided | Code | Quantity | Unit | | Unit Price | Amount |
|-------------|-----|---|--|----------------------------------|----------------------|-------------------|----------------|-----------------------------------|----------|
| 02/15/2011 | 1 | 1, 2 | Liquid & Plastic Limits (D 4318) Percent Passing #200 Sieve (D 1140) OMD Standard Compaction (D 698) | 90100.00 90600.00 92300.00 | 1.00 1.00 1.00 | Ea. Ea. Ea. | \$ \$ \$ | 53.00 \$ 41.00 \$ 175.00 \$ | 41.00 |
| 02/21/2011 | | 3, 4 | Liquid & Plastic Limits (D 4318) OMD Standard Compaction (D 698) | 90100.00 92300.00 | 1.00 1.00 | Ea. Ea. | \$ \$ | 53.00 \$ 175.00 \$ | |
| | A | Attachments: | Test Reports | | | | TOTA | L \$ | 497.00 |
| | | *************************************** | Billing Sumi | mary | | | | | 4,007.50 |
| | | | Amount of this Invoice Amount Billed Previously | | | | \$ \$ | 497.00 0.00 | 4,007.50 |

Stander for the annual of the file of the following the fo P.O. # 58428 Act # 462 - Kendleton

அர் அரசும் கடருக்கு குண்ணு

MAR 1 4 2011

GEOTEST ENGINEERING, INC. 5600 Bintliff Drive Houston, Texas 77036 Tel. (713) 266-0588

REPORT OF CLIENT DELIVERED SAMPLE

Project:

Material Testing for Kendleton Wastewater Treatment Plant

Job No.:

11502244-01

Fort Bend County

Report No.:

No.: 1

Contractor:

Date:

2-15-11

Given below is a list of samples received by our laboratory:

One soil sample for proctor, PI & -200

Remarks:

Distribution:

Fort Bend County/Karen A. Bringol (email) Jacobs Engineering/Vernon H. Webb II, P.E. (email) Invoice (1)


Project Manager

Collin Nguyen, E.I.T.

TBPE Registration No. F-410

2-23-11

Date

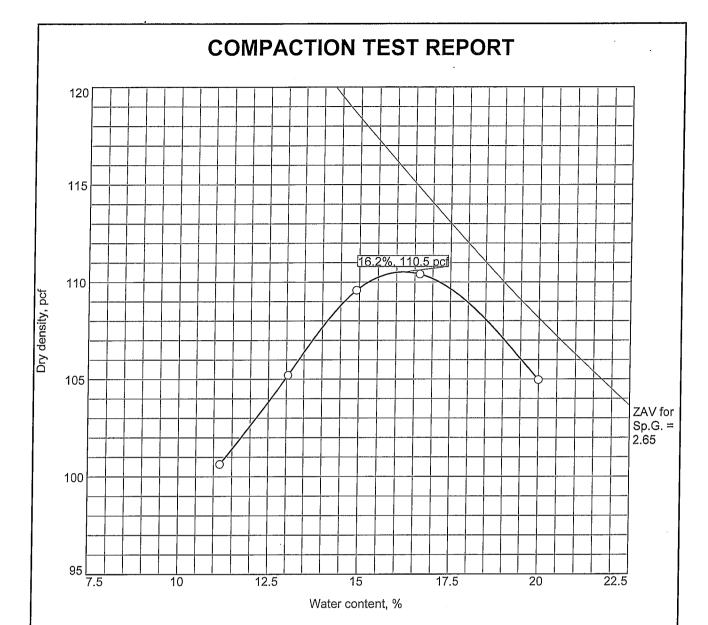

Test specification: ASTM D 698-07 Method A Standard

| Elev/ | Classi | Nat. | Sp.G. | ~ C II | PI | % > | % < | |
|-------|--------|--------|--------|----------|----|-----|-----|--------|
| Depth | USCS | AASHTO | Moist. | Sp.G. | LL | F1 | #4 | No.200 |
| | CL | | 16.6 | 2.65 | 49 | 30 | | 86 |

| TEST RESULTS | MATERIAL DESCRIPTION | | | | | |
|--|---|--|--|--|--|--|
| Maximum dry density = 110.5 pcf | Reddish brown & gray Lean Clay Curve No. 1 | | | | | |
| Optimum moisture = 16.2 % | | | | | | |
| Project No. 1150-2244 Client: Fort Bend County Community Development | Remarks: | | | | | |
| Project: Material Testing for Kendleton WWTP | Sampled 2/15/11 Report No. 2 | | | | | |
| Fort Bend County, Texas | Ravi Cartamantala, P.E. Date: 5-1 | | | | | |
| O Location: Contractor Delivered Sample Number: 10979 | ASTM D2216,D2487,D2850,D4318,D854 | | | | | |
| GEOTEST ENGINEERING, INC. | Assumed SPG | | | | | |
| Houston, TX | | | | | | |

Tested By: J. Keys Checked By: C. Nguyen

GEOTEST ENGINEERING, INC.

5600 Bintliff Drive Houston, Texas 77036 Tel. (713) 266-0588

REPORT OF CLIENT DELIVERED SAMPLE

Project:

Contractor:

Material Testing for Kendleton Wastewater Treatment Plant

Fort Bend County

Job No.:

11502244-01

Report No.:

3

Date:

2-21-11

Given below is a list of samples received by our laboratory:

One soil sample for proctor and PI testing

Remarks:

Distribution:

Fort Bend County/Karen A. Bringol (email)

Jacobs Engineering/Vernon H. Webb II, P.E. (email)


Invoice (1)

Collin Nguyen, E.I.T.

TBPE Registration No. F-410

Additional information requested to be reported by ASTM is provided in the project file
The results of this report pentain only to the items and locations tested. This report shall not be reproduced except in full without written approval of Geotest Engineering, Inc. RCDS.REP

COMPACTION TEST REPORT

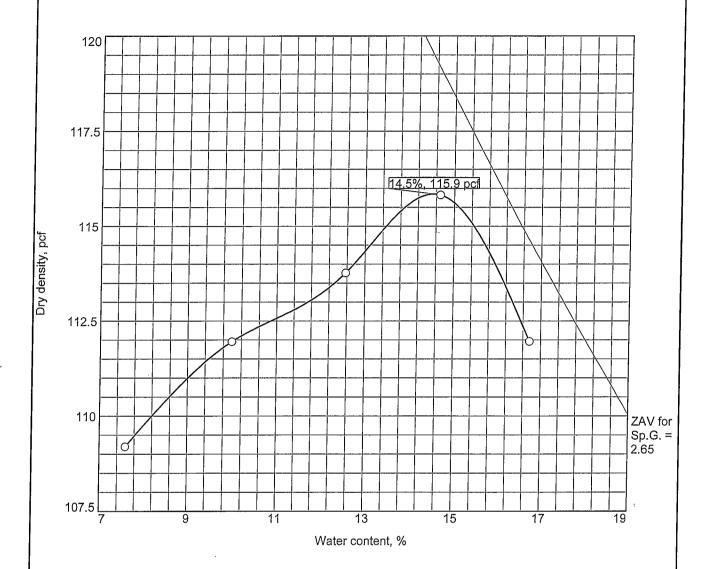

Test specification: ASTM D 698-07 Method A Standard

| Elev/ | Classification | | | C= C | | D. | % > | % < |
|-------|----------------|--------|--------|-------|----|----|-----|--------|
| Depth | USCS | AASHTO | Moist. | Sp.G. | | PI | #4 | No.200 |
| | CL | | 12.6 | 2.65 | 30 | 14 | | N/A |

| TEST RESULTS | MATERIAL DESCRIPTION | | | |
|--|--|--|--|--|
| Maximum dry density = 115.9 pcf | Reddish brown Sandy Lean Clay Curve No. 2 | | | |
| Optimum moisture = 14.5 % | | | | |
| Project No. 1150-2244 Client: Fort Bend County Community Development | Remarks: | | | |
| Project: Material Testing for Kendleton WWTP | Sampled 2/21/11 Report No. 4 | | | |
| Fort Bend County, Texas | Ray Yanamandala, P.E. Date: | | | |
| O Location: Contractor Delivered Sample Number: 10991 | ASTM D2216, D2487, D2850, D4318, D854 | | | |
| GEOTEST ENGINEERING, INC. | Assumed SPG | | | |
| | | | | |
| Houston, TX | | | | |

Tested By: J. Keys Checked By: C. Nguyen