

REVIEW BY FORT BEND COUNTY COMMISSIONERS COURT

On this 12 day of OCTOBER, 2010, before the Fort Bend Commissioners Court came on to be heard and reviewed the accompanying notice of CENTERPOINT ENERGY

Job Location FLEWELLEN CREEK

Dated 10/01/10 BOND NO 22001420 Permit No. 83835
to make use of certain Fort Bend County property subject to, "A Revised Order Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables, Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners Court of Fort Bend County, Texas, date the 3rd day of August, 1987, recorded in Volume _____ of the Minutes of the Commissioners Court of Fort Bend County, Texas, to the extent that such order is not inconsistent with Article 1436a, Vernon's Texas Civil Statutes. Upon Motion of Commissioner Meyers, seconded by Commissioner Patterson, duly put and carried, it is ORDERED, ADJUDGED AND DECREED that said notice of said above purpose is hereby acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said notice be placed on record according to the regulation order thereof.

Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
 - a. 48 hours in advance of construction start up, and
 - b. When construction is completed and ready for final inspection

Mail notices to: Permit Administrator
Fort Bend County Engineering
P.O. Box 1449
Rosenberg, Texas 77471
281-633-7500

3. This permit expires one (1) year from date of permit if construction has not commenced.

By

[Signature]
County Engineer

By

[Signature]
Drainage District Engineer/Manager

Presented to Commissioners Court and approved.

Recorded in Volume 10-12-10
Minutes of Commissioners Court.

Clerk of Commissioners Court

By [Signature]
Deputy

NOTICE OF PROPOSED CABLE, CONDUIT AND/OR POLE LINE ACTIVITY
IN, UNDER, ACROSS OR ALONG ROADS, STREETS, HIGHWAYS AND DRAINAGE DITCHES
IN FORT BEND COUNTY

APPLICANT'S JOB NO. 1402260016
PERMIT No. 83835 PCT. No. 3
BOND No. 22001420

Formal notice is hereby given that Center Point Energy
proposes to ~~lay~~, construct, maintain and/or repair cable, conduit and/or pole line, ~~in, under,~~
across, ~~or along~~ roads, streets, highways and drainage ditches in Fort Bend County, as follows:

~~In, Under, or Across Roads and/or Drainage Ditches~~

Road or Ditch Name	Distance & Direction From	Length of Crossing	Type of Construction
<u>Flewetten</u>	<u>1500'± NNW</u>	<u>310'±</u>	<u>overhead electric</u>
<u>Ditch</u>	<u>Cross Cr. Bend @</u>		<u>line</u>
<u>Morgans Spur</u>			

Along Roads and/or Drainage Ditches

Road or Ditch Name	Distance & Direction From	To	Distance

General Description

At the location for crossing, set poles one foot outside the Drainage District ROW on east and west side, in an existing utility easement. Lowest conductor to be approximately 30ft above ground.

The Location and description of the proposed installation and appurtenances is more fully shown on the attached detail drawings. The laying, construction, maintenance and/or repair of the proposed installation shall be subject to "A Revised Order Regulating the Laying, Construction, Maintenance and/or Repair of Cables, Conduits, and/or Pole Lines, In, Under, Across, or Along Roads, Streets, Highways and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by Commissioners Court of Fort Bend County, Texas, dated the 3rd. day of August, 1987, recorded in Volume 639 of the Minutes of the Commissioners Court of Fort Bend County, Texas.

Written notices are required: 1) 48 hours in advance of start of construction and
2) when construction is complete and ready for final inspection.

Mail to: Permit Administrator/Fort Bend County Engineering
P.O. Box 1449, Rosenberg, TX 77471.

Violation of requirements shall constitute grounds for job shut down.

Does project
comply with Fort
Bend County
Outdoor Lighting
Ordinance?

Yes ()

No ()

COMPANY NAME: Center Point Energy
AGENT and/or OWNER

Stanley G. Short
(Signature)

NAME & TITLE Stanley G. Short Sr. Svc. Cons.
(Please Print)

DATE Sept. 24, 2010

ADDRESS 13300 W. Bellfort
(Street/P.O. Box)
Houston Tx 77099
City State Zip

TELEPHONE NO: 281-561-3228
(accessible 24 hrs/day, 7 days/week)

58 AMJ

40T

AO

MORGANS SPUR DR

Exist.
overhead
line

2 Approx. FBCDD
Flewollen Ditch
Boundary 2

310'

Required
pole

Required
overhead
line

pipeline

Pipeline


CENTERPOINT ENERGY


NOTES:

Scale 1 inch : 100.00 feet



WORK ORDER #	MAIN WORK CENTER	ID NUMBER	FUNCTIONAL LOCATION
1402260016	KATY		
GLN NUMBER	KEY MAP	ORDER TYPE	MAINT ACCT TYPE
425414	523H		
CONSULTANT	PHONE NUMBER	PAGER NUMBER	EMAIL
SHORT	281-561-3228		
DATE REQUESTED	FIELD COMPLETION DATE	ADDRESS	GIS PRIORITY
			1 2 3 4 5

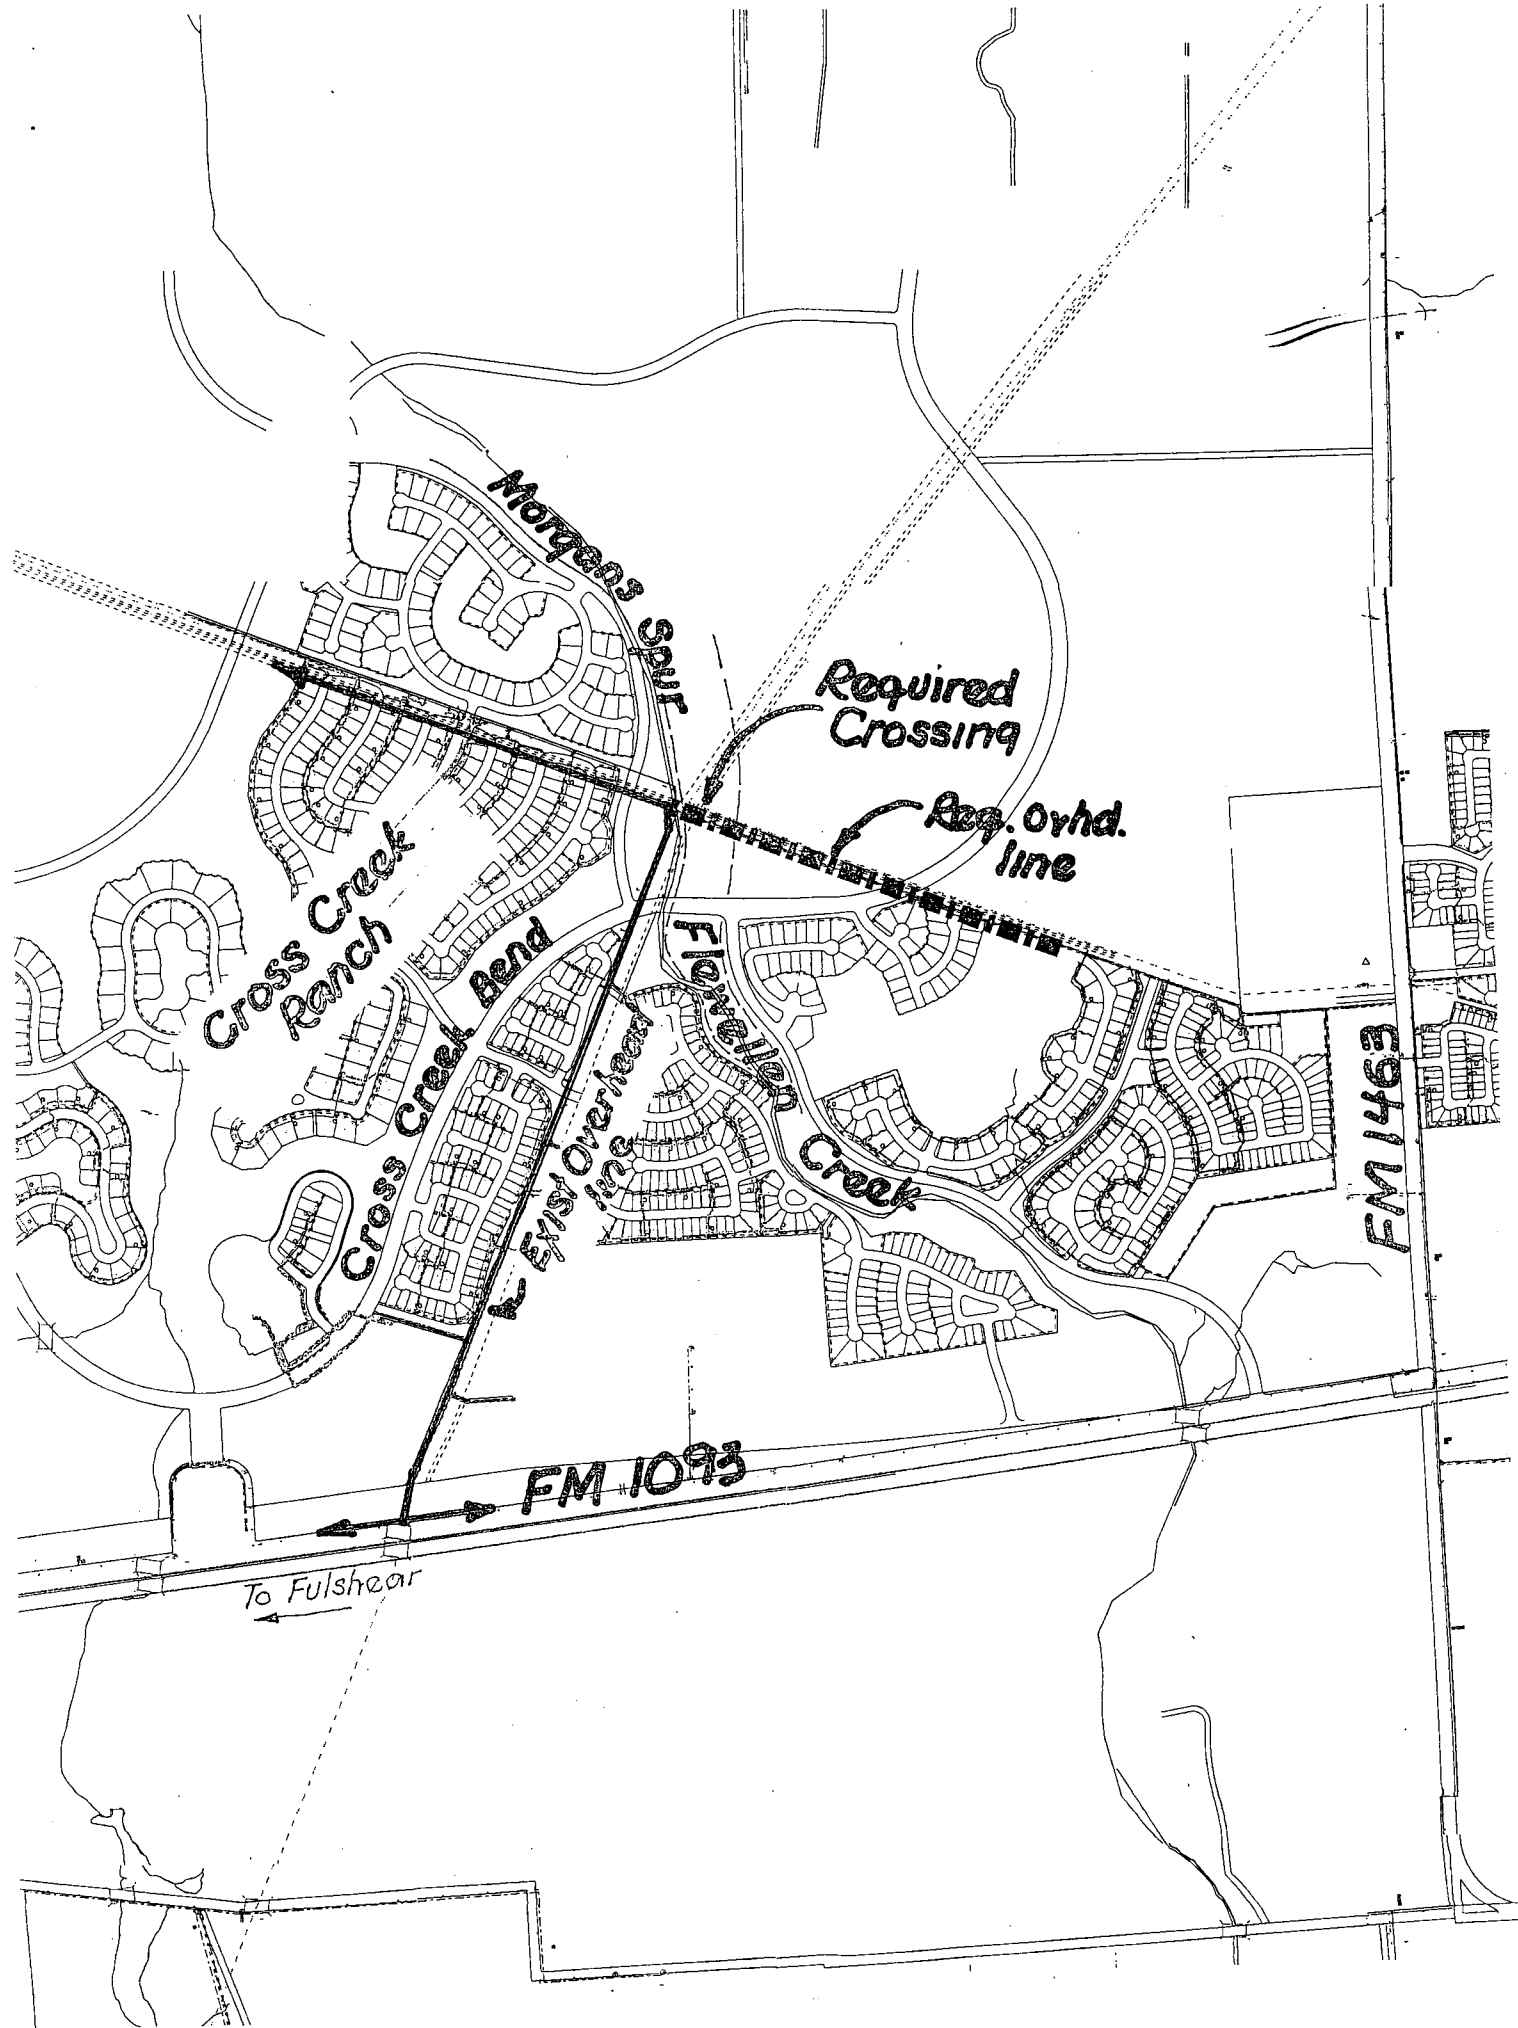

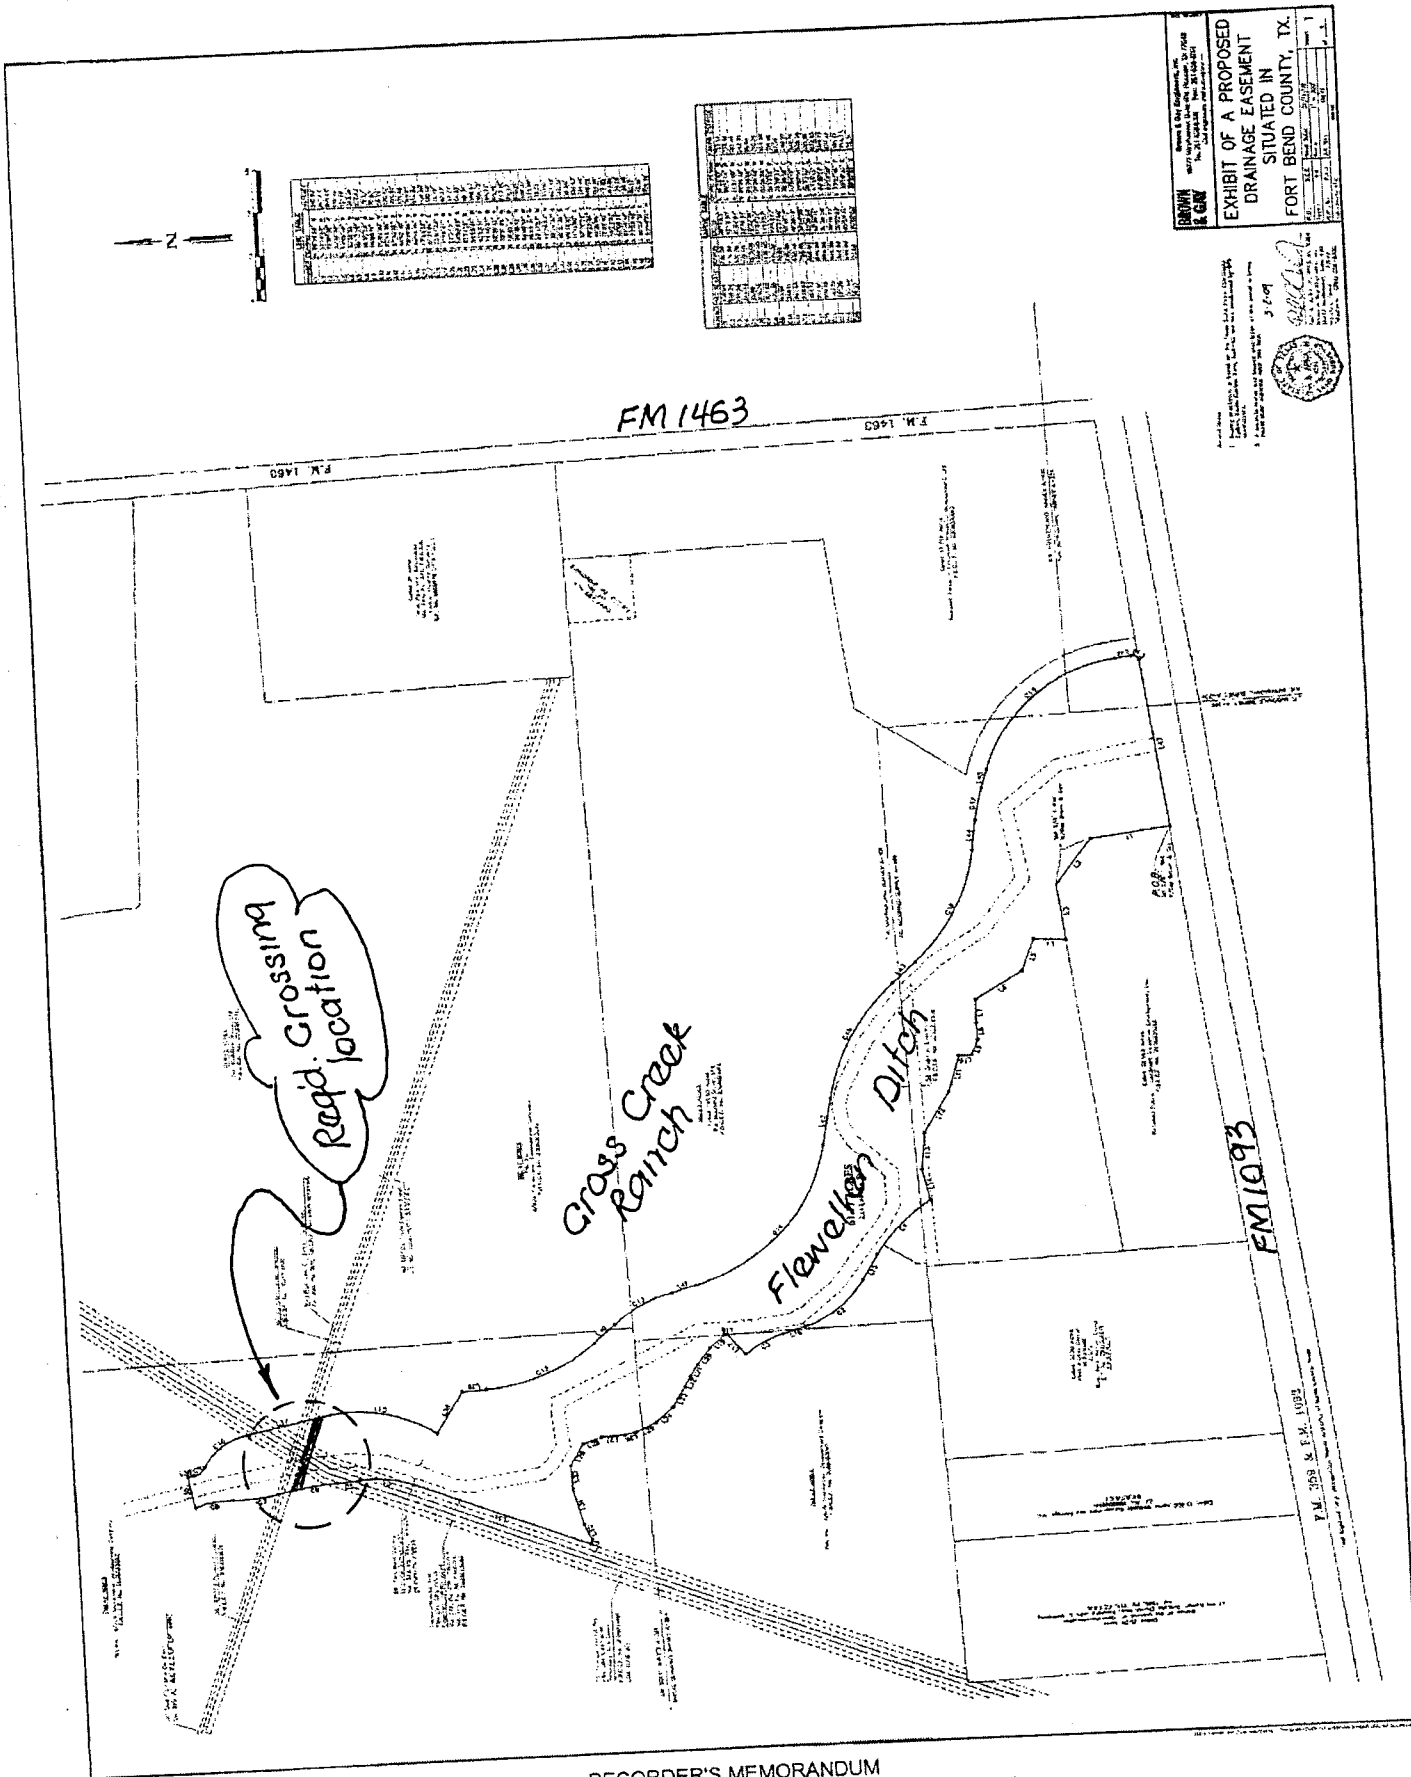

1402260016