

8K

# REVIEW BY FORT BEND COUNTY COMMISSIONERS COURT

On this 12 day of APRIL, 2011, before the Fort Bend Commissioners Court came on to be heard and reviewed the accompanying notice of CENTERPOINT ENERGY ENTEX

Job Location UNIVERSITY BOULEVARD

Dated 03/28/11 BOND NO 22-022-417 Permit No. 83932  
to make use of certain Fort Bend County property subject to, "A Revised Order Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables, Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners Court of Fort Bend County, Texas, date the 3<sup>rd</sup> day of August, 1987, recorded in Volume \_\_\_\_\_ of the Minutes of the Commissioners Court of Fort Bend County, Texas, to the extent that such order is not inconsistent with Article 1436a, Vernon's Texas Civil Statutes. Upon Motion of Commissioner Meyers, seconded by Commissioner Patterson, duly put and carried, it is ORDERED, ADJUDGED AND DECREED that said notice of said above purpose is hereby acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said notice be placed on record according to the regulation order thereof.

## Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
  - a. 48 hours in advance of construction start up, and
  - b. When construction is completed and ready for final inspection

Mail notices to: Permit Administrator  
Fort Bend County Engineering  
P.O. Box 1449  
Rosenberg, Texas 77471  
281-633-7500

3. This permit expires one (1) year from date of permit if construction has not commenced.

By

County Engineer

By

N/A  
Drainage District Engineer/Manager

Presented to Commissioners Court  
and approved.

Recorded in Volume 4-12-11  
Minutes of Commissioners Court.

Clerk of Commissioners Court

By Sherry Fion  
Deputy

# COUNTY OF FORT BEND

## Engineering Department

P.O. BOX 1449  
Rosenberg, Texas 77471-1449

Johnny Ortega  
Permit Administrator

1124 Blume Road  
Phone: (281) 341-7500

### PERMIT APPLICATION REVIEW FORM FOR CABLE, CONDUIT, AND POLE LINE ACTIVITY IN FORT BEND COUNTY

PERMIT NO. 083932

The following "Notice of Proposed Cable, Conduit, and/or Pole Line activity in Fort Bend County" and accompanying attachments have been reviewed and the notice conforms to appropriate regulations set by Commissioner's Court of Fort Bend County, Texas.

- X (1) Complete Application Form.
- X a. Name of road, street, and/or drainage ditch affected.
- X b. Vicinity map showing course of direction.
- c. Plans and specifications.

- (2) Bond:
- District Attorney, approval when applicable.
- X Perpetual bond currently posted.
- No. 22-022-417
- Amount \$50,000.00
- Performance bond submitted.
- No.
- Amount
- Cashier's Check.
- No.
- Amount


- (3) Verbal permission given for emergencies, to start construction before approved in Commissioner's Court.

       Precinct Engineer Acknowledgment        Date       

       Precinct Commissioner Acknowledgment        Date       

- (4)
- Drainage District Approval when applicable

We have reviewed this project and agree it meets minimum requirements.

  
Johnny Ortega CFM/ Permit Administrator  
(REVISED 5/30/08)

03/28/2011  
Date

NOTICE OF PROPOSED CABLE, CONDUIT AND / OR POLE LINE ACTIVITY  
IN, UNDER, ACROSS OR ALONG ROADS, STREETS, HIGHWAYS AND DRAINAGE DITCHES  
IN FORT BEND COUNTY

APPLICANT'S JOB NO. 57307790  
PERMIT NO. 83932 PCT. NO. 4  
BOND NO. 22-022-417

Formal notice is hereby given that CENTERPOINT ENERGY ENTEx  
proposes to lay, construct, maintain and / or repair cable, conduit, and / or pole  
line, in, under, across, or along roads, streets, highways and drainage  
ditches in Fort Bend County, as follows:

In, Under, or Across Roads, and / or Drainage Ditches

Road or Ditch Name	Distance & Direction From Nearest Intersection	Length of Crossing	Type of Construction:			
			Bored	Jacked	Driven	Cased
University Blvd	Tapping @ 745'+- SS HWY 6	3'	X			
Blk						

Along Roads and / or Drainage Ditches

Road or Ditch Name	Distance & Direction From Nearest intersection	To	Distance

General Description

The location and description of the proposed installation and appurtenances is more fully shown on the attached detail drawings. The laying, construction, maintenance and / or repair of the proposed installation shall be subject to "A Revised Order Regulating the Laying, Construction, Maintenance and / or Repair of Cables, Conduits, and / or Pole Lines, In, Under, Across, or Along Roads, Streets, Highways and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by Commissioners Court of Fort Bend County, Texas, dated the 3rd. day of August, 1987, recorded in Volume 639 of the Minutes of the Commissioners Court of Fort Bend County, Texas.

Written notices are required: 1) 48 hours in advance of start of construction and 2) when construction is complete and ready for final inspection.

Mail To: Permit Administrator / Fort Bend County Engineering  
P. O. Box 1449, Rosenberg, Texas 77471

Violation of requirements shall constitute grounds for job shut down.

COMPANY NAME: CenterPoint Energy Entex  
AGENT and / or OWNER

SIGNATURE: Ravinder Duggal

NAME & TITLE RAVINDER DUGGAL  
Operations Engineer ADV. ENGINEERING COORDINATOR  
(Please Print)

DATE: MARCH 23, 2011


ADDRESS: 1111 Louisiana -Rm 1265D  
(Street / P.O. Box)

Houston Texas 77002  
City State Zip

TELEPHONE NO: (713) 207-4601- Gloria Malone  
(accessible 24 hrs/day, 7 days/week)

Does project comply with Fort Bend County Outdoor Lighting Ordinance? \_X\_ Yes \_\_\_ No

6' VARIES)

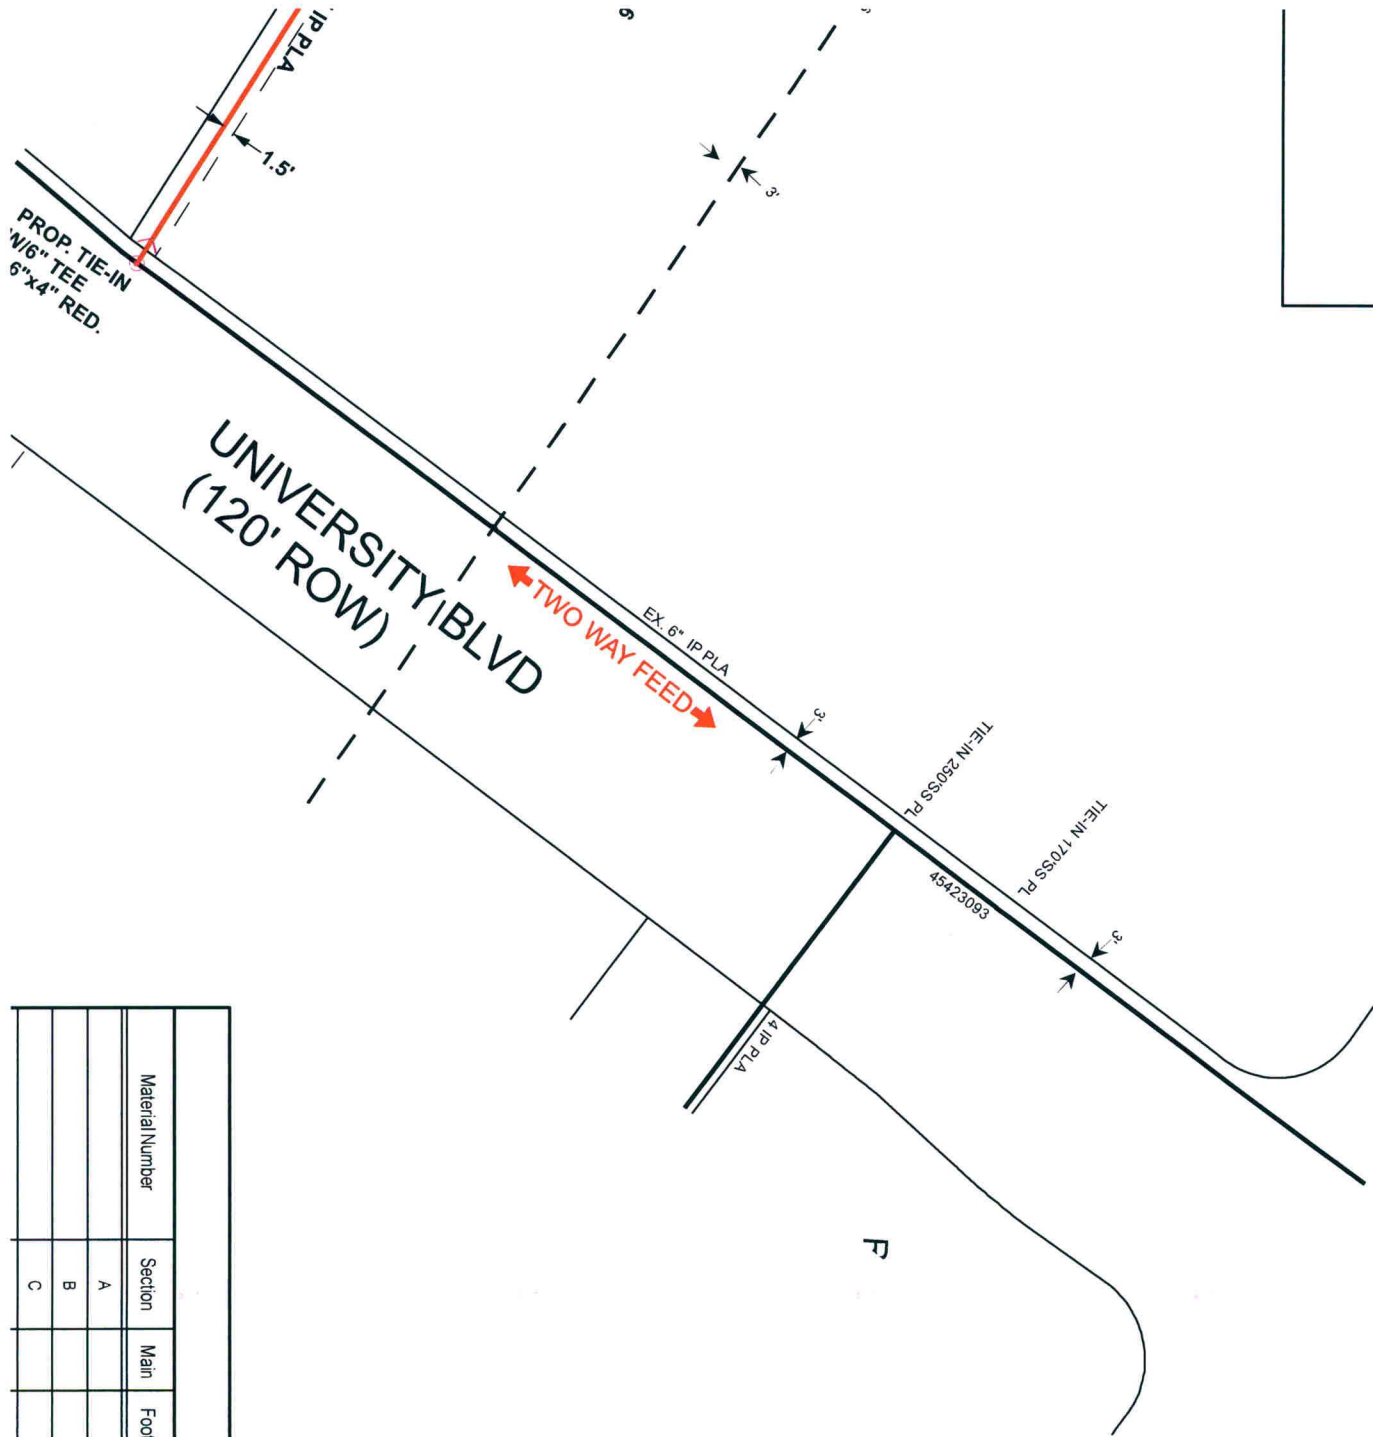

- GENERAL NOTES:
- 1- ALL STREETS ARE 60' ROW UNLESS OTHERWISE NOTED.
  - 2- GAS MAINS ARE IN STANDARD "JOINT TRENCH LOCATION". REFER TO E44-98259, E44-98231 & E44-98224.
  - 3- CRITERIA TO BE USED FOR TRACER WIRE SELECTION WHEN INSTALLING PLASTIC GAS LINES:
    - A- USE #14 TRACER WIRE FOR ALL RESIDENTIAL SERVICE LINES.
    - B- USE #14 TRACER WIRE FOR SHORT BORES UP TO 300' AND OTHER NON-BORE INSTALLATIONS.
    - C- USE #10 TRACER WIRE WITH A BORES LONGER THAN 300'.
    - D- USE #8 TRACER WIRE AS NEEDED FOR LARGE BAYOU CROSSING AND OTHER EXTRAORDINARY SITUATIONS AND COMPLEX BACKSIGHTS. INSPECTOR APPROVAL REQUIRED PRIOR TO WORK.
  - 4- TEST PRESSURE 100 PSIG

**GAS STAKING**

JOB NO: \_\_\_\_\_ BY: \_\_\_\_\_ DATE: \_\_\_\_\_

ESMTS. DED. BY: \_\_\_\_\_ ESMT. DOCUMENTS: \_\_\_\_\_

MONUMENTATION FND: \_\_\_\_\_ PLAT DIST. CHK-D

ESMTS. NEEDED AT: \_\_\_\_\_

NON-STD. STAKING: \_\_\_\_\_ REASON: \_\_\_\_\_

**LOT NUMBER CHART**

Material Number	Section	Main	Footage	Pipe Cat.	Lot Number	Fusion Method			
	A					EF	BF	SF	S
	B								
	C								