

REVIEW BY FORT BEND COUNTY COMMISSIONERS COURT

On this 23 day of APRIL, 2013, Commissioners Court
came on to be heard and reviewed the accompanying notice
of CITY OF ROSENBERG

Job Location SEABOURNE CREEK

Dated 04/08/13 Bond No. NO BOND REQUIRED, Permit No. 84331
to make use of certain Fort Bend County property subject to, "A Revised Order
Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables,
Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and
Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the
Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners
Court of Fort Bend County, Texas, date the 3rd day of August, 1987, recorded in
Volume _____ of the Minutes of the Commissioners Court of Fort Bend County,
Texas, to the extent that such order is not inconsistent with Article 1436a, Vernon's
Texas Civil Statutes. Upon Motion of Commissioner Meyers, seconded
by Commissioner Atkinson, duly put and carried, it is ORDERED,
ADJUDGED AND DECREED that said notice of said above purpose is hereby
acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said
notice be placed on record according to the regulation order thereof.

Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site
and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
 - a. 48 hours in advance of construction start up, and
 - b. When construction is completed and ready for final inspection

Mail notices to: Permit Administrator
Fort Bend County Engineering
P.O. Box 1449
Rosenberg, Texas 77471
281-633-7500

3. This permit expires one (1) year from date of permit if construction has not
commenced.

By Louis G. Hood 4/23/13
County Engineer
Assistant

By _____
Drainage District Engineer/Manager

Presented to Commissioners Court
and approved.

Recorded in Volume 4-23-13
Minutes of Commissioners Court.

Clerk of Commissioners Court

By Sherry Fish
Deputy

COUNTY OF FORT BEND

Engineering Department

P.O. BOX 1449
Rosenberg, Texas 77471-1449

Johnny Ortega
Permit Administrator

1124 Blume Road
Phone: (281) 341-7500

PERMIT APPLICATION REVIEW FORM FOR CABLE, CONDUIT, AND POLE LINE ACTIVITY IN FORT BEND COUNTY

PERMIT NO. 084731

The following "Notice of Proposed Cable, Conduit, and/or Pole Line activity in Fort Bend County" and accompanying attachments have been reviewed and the notice conforms to appropriate regulations set by Commissioner's Court of Fort Bend County, Texas.

- X (1) Complete Application Form.
- X a. Name of road, street, and/or drainage ditch affected.
- X b. Vicinity map showing course of direction.
- X c. Plans and specifications.

- X (2) Bond: **NO BOND REQUIRED**
- District Attorney, approval when applicable.
- Perpetual bond currently posted.
- No. _____
- Amount _____
- Performance bond submitted.
- No. _____
- Amount _____
- Cashier's Check.
- No. _____
- Amount _____

- (3) Verbal permission given for emergencies, to start construction before approved in Commissioner's Court.

Precinct Engineer Acknowledgment

Date

Precinct Commissioner Acknowledgment

Date

- (4) *Adam Wright*
Drainage District Approval when applicable

We have reviewed this project and agree it meets minimum requirements.

Johnny Ortega
Johnny Ortega CFM/ Permit Administrator
(REVISED 5/30/08)

04/04/2013
Date

NOTICE OF PROPOSED CABLE, CONDUIT AND/OR POLE LINE ACTIVITY
IN, UNDER, ACROSS OR ALONG ROADS, STREETS, HIGHWAYS AND DRAINAGE DITCHES
IN FORT BEND COUNTY

APPLICANT'S JOB NO. Rosenberg / Walsh Road Water Line Extension

PERMIT No. 84331 PCT. No. 1

BOND No. No Bond Required

Formal notice is hereby given that City of Rosenberg
proposes to lay, construct, maintain and/or repair cable, conduit and/or pole line, in, under,
across, or along roads, streets, highways and drainage ditches in Fort Bend County, as follows:

In, Under, or Across Roads and/or Drainage Ditches

Road or Ditch Name	: Distance & Direction From : Nearest Intersection	: Length of : Crossing	: Type of Construction : Bored: Jacked: Driven: Cased
<u>Seabourne Creek</u>	<u>at Walsh Road</u>	<u>100 feet</u>	<u>✓</u> : : :
:	:	:	: : :
:	:	:	: : :

Along Roads and/or Drainage Ditches

Road or Ditch Name	: Distance & Direction From : Nearest Intersection	: To :	: Distance :
:	:	:	:
:	:	:	:
:	:	:	:

General Description

2" PVC water line extension in Walsh Road Right-of-Way, will cross

Seabourne Creek on east side of Walsh Road Right-of-Way - depth - 5 feet below flow line

The Location and description of the proposed installation and appurtenances is more fully shown on the attached detail drawings. The laying, construction, maintenance and/or repair of the proposed installation shall be subject to "A Revised Order Regulating the Laying, Construction, Maintenance and/or Repair of Cables, Conduits, and/or Pole Lines, In, Under, Across, or Along Roads, Streets, Highways and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by Commissioners Court of Fort Bend County, Texas, dated the 3rd. day of August, 1987, recorded in Volume 639 of the Minutes of the Commissioners Court of Fort Bend County, Texas.

Written notices are required: 1) 48 hours in advance of start of construction and
2) when construction is complete and ready for final inspection.

Mail to: Permit Administrator/Fort Bend County Engineering
P.O. Box 1449, Rosenberg, TX 77471.

Violation of requirements shall constitute grounds for job shut down.

COMPANY NAME: City of Rosenberg
AGENT and/or OWNER

John Maresh
(Signature)

NAME & TITLE John Maresh, Assistant City Manager
(Please Print)

DATE 4-4-13

ADDRESS 2220 4th Street / P.O. Box 32
(Street/P.O. Box)

Rosenberg TX 77471
City State Zip


TELEPHONE NO. (832) 595-3200 or (832) 595-3700
(accessible 24 hrs/day, 7 days/week)

Does project
comply with Fort
Bend County
Outdoor Lighting
Ordinance?

Yes ()

No ()

SEE 603 MAP

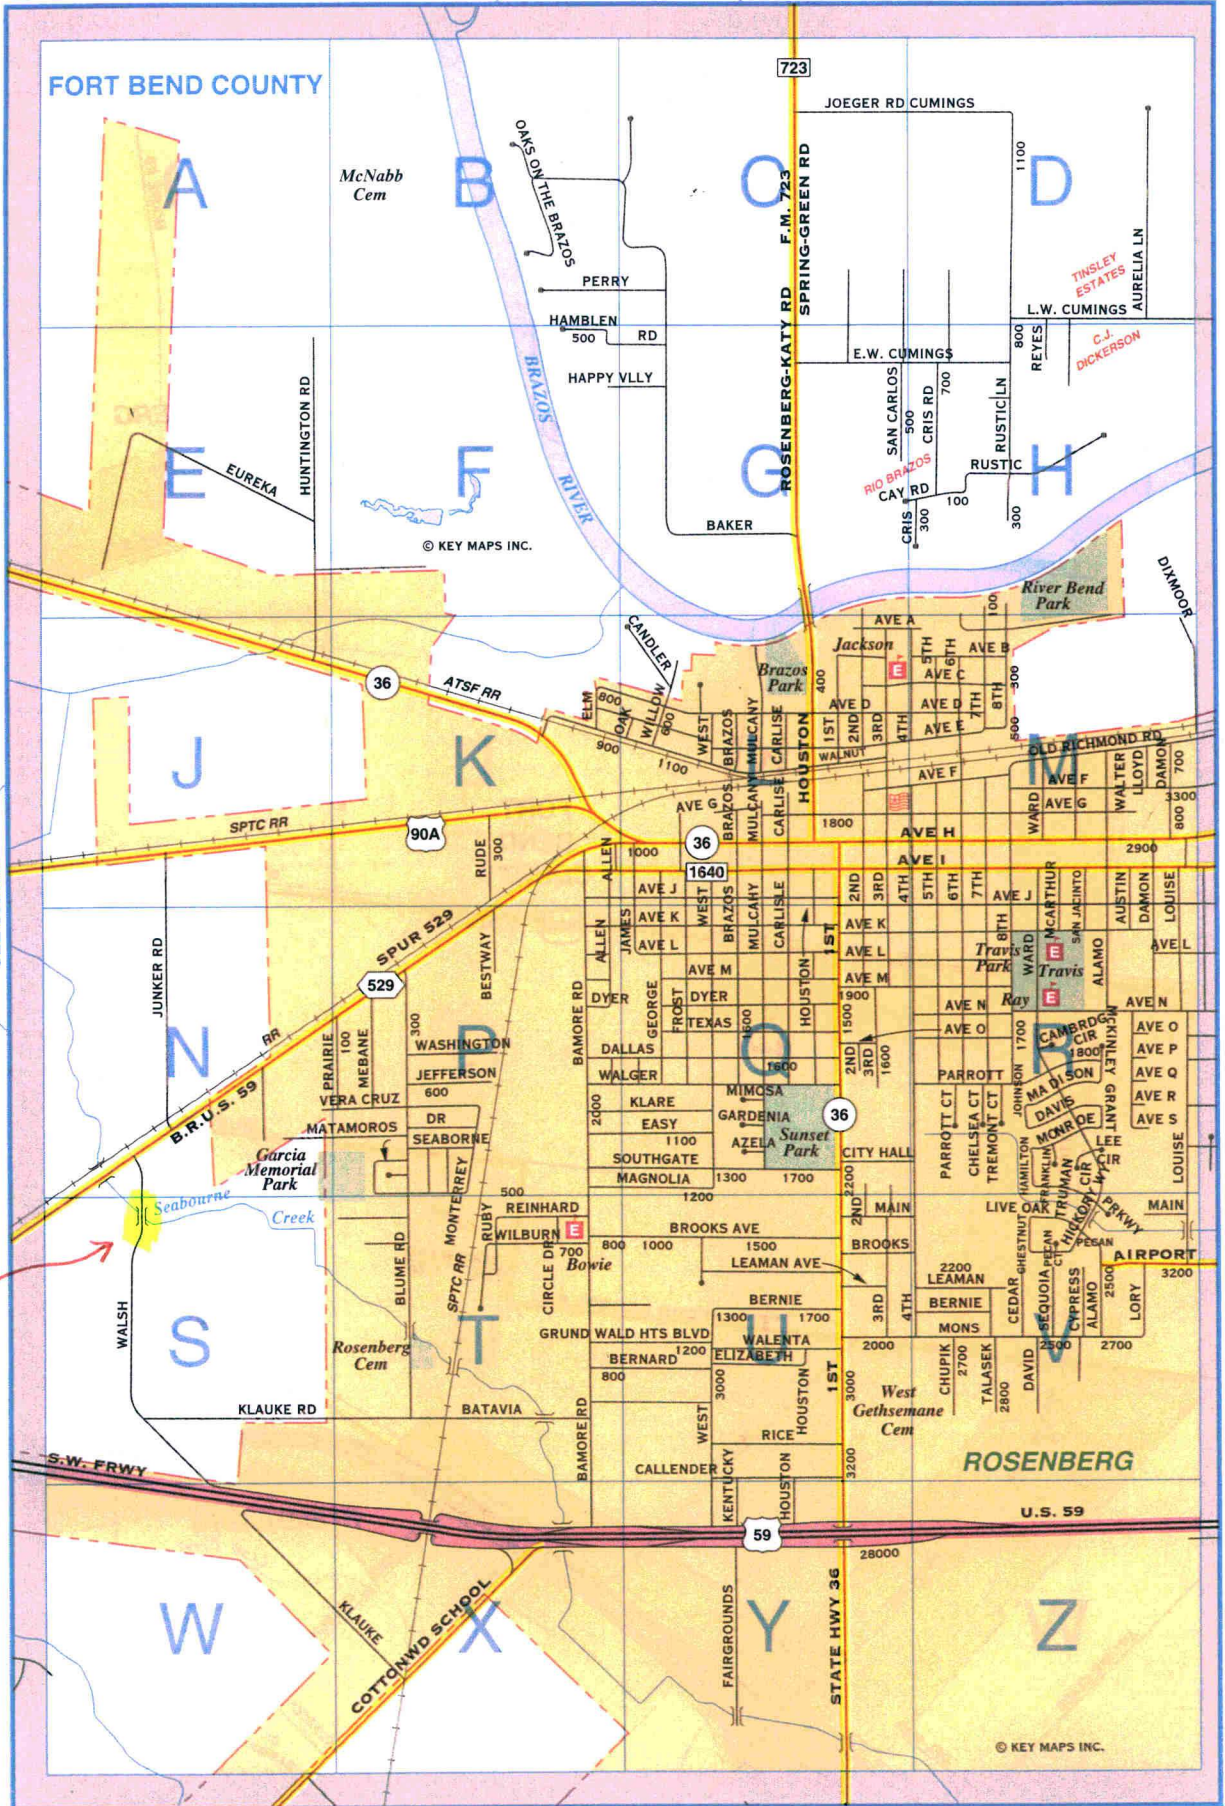

4-4-13

City of Rosenberg

Returning to Previous View

Backspace will take you to previous views.
Use control+backspace to redo.

X

Spur 529

Location of 2" water line crossing - 5' below creek flowline

Seabourne Creek

Walsh Road

© 2013 Google

Google earth

Imagery Date: 4/21/2012 29°32'37.72"N 95°50'19.24"W elev 100 ft eye alt 2005 ft

4-4-13

City of Rosenberg
2" Water Line Extension
Along East Side of
Walsh Road Right-of-Way

1
N

SPUR 529

2" PVC water line installed in
Walsh Road ROW, 4' cover typical

Seabourne Creek

Proposed 2" PVC water line to be
installed by bore under Seabourne
Creek, minimum 5' depth below
creek flow line

Walsh Road
Asphalt pavement
existing

Walsh Road Right of Way
width varies

* Not to Scale