

REVIEW BY FORT BEND COUNTY COMMISSIONERS COURT

On this 7th day of June, 2016, Commissioners Court came on to be heard and reviewed the accompanying notice of CenterPoint Energy

Job Location 7945 W Grand Pkwy S, Houston, TX 77407

Date 5/17/2016 Bond No. 22-022-417, Permit No. 2016-7191 to make use of certain Fort Bend County property subject to, "A Revised Order Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables, Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners Court of Fort Bend County, Texas the 3rd day of August, 1987, recorded in Volume _____ of the Minutes of the Commissioners Court of Fort Bend County, Texas, to the extent that such order is not inconsistent with Article 1436a, Vernon's Texas Civil Statutes. Upon Motion of Commissioner Mejers, seconded by Commissioner Patterson, duly put and carried, it is ORDERED, ADJUDGED AND DECREED that said notice of said above purpose is hereby acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said notice be placed on record according to the regulation order thereof.

Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
 - a. 48 hours in advance of construction start up, and
 - b. when construction is completed and ready for final inspection

Mail notices to: Permit Administrator
Fort Bend County Engineering
301 Jackson Street
Richmond, Texas 77469
281-633-7500
3. This permit expires one (1) year from date of permit if construction has not commenced.

By: Chris O-Ad
County Engineer

By: N/A
Drainage District Engineer/Manager


Presented to Commissioners Court and approved.

Recorded in Volume 6/7/16 12B
Minutes of Commissioners Court

Clerk of Commissioners Court

By: [Signature]
Deputy **RENEE MICHULKA**

5/3/2016 1:31:35 PM 0:\REVENUE_2016\RAWINDER_DUGGAL\TEXAS_COAST\COMMERCIAL_SVCS\7945 - GRAND PKWY_S\EB5-16389.dwg

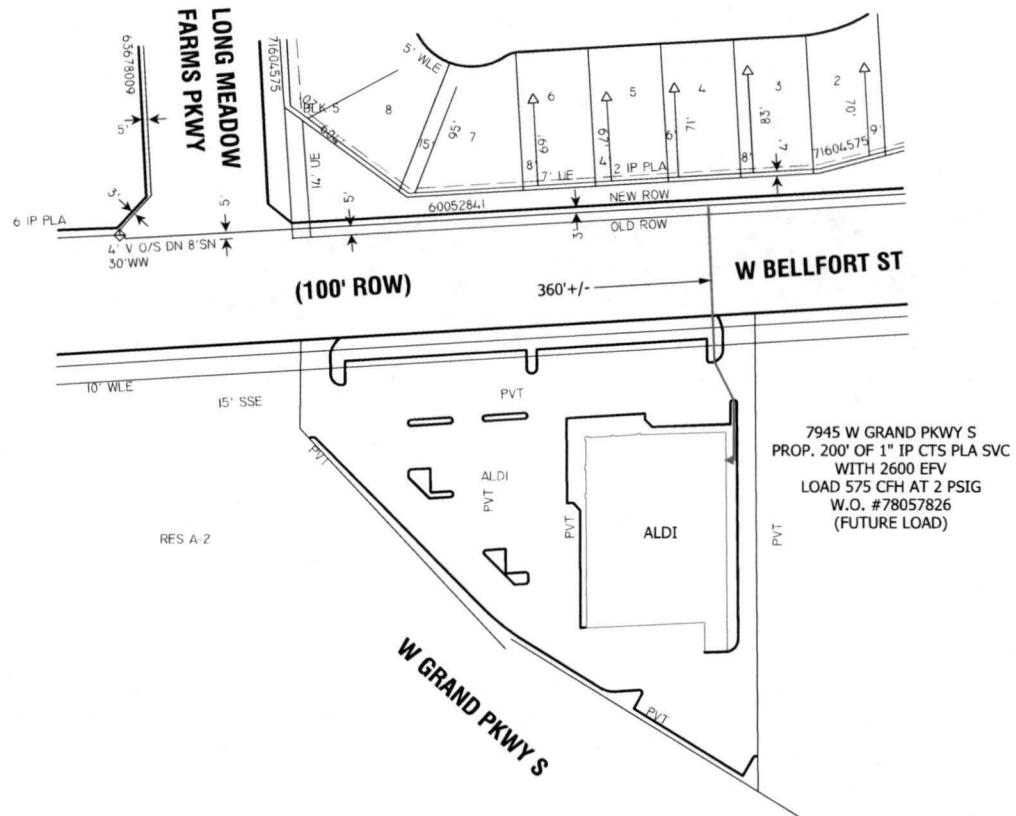

**MAINTAINED BY C.O.H.
NO PERMIT NEEDED**

7945 W GRAND PKWY S
PROP. 200' OF 1" IP CTS PLA SVC
WITH 2600 EPV
LOAD 575 CFH AT 2 PSIG
W.O. #78057826
(FUTURE LOAD)

LEGEND AND NOTES	
EX. MAIN _____	GENERAL NOTES:
PROP. 1" IP CTS PLA SVC _____ 200'	CRITERIA TO BE USED FOR TRACER WIRE SELECTION WHEN INSTALLING PLASTIC GAS LINES:
SDR11.5 PE 2406/2708	1- USE #14 TRACER WIRE FOR ALL RESIDENTIAL SERVICE LINES.
W.O. #78057826	2- USE #4 TRACER WIRE FOR SHORT BORES UP TO 500' AND ALL OTHER NON-BORER INSTALLATIONS.
TEST PRESSURE 100 PSIG	3- USE #6 TRACER WIRE WITH ALL BORES LONGER THAN 500'.
NOTIFICATION#: 1403870948	4- USE #8 TRACER WIRE AS NEEDED FOR LARGE BAY/ CROSSINGS AND OTHER EXTRAORDINARY SITUATIONS AND COMPLEX BORES. INSPECTOR APPROVAL REQUIRED PRIOR TO WORK.
F:30330680 O:30240680 KM:526W LAMBERT:4553 Z: SZ:501 TC:30 SOG:07601	
DESIGNED BY: RAVINDER DUGGAL	CONTRIBUTION:
ESTIMATED COST:	
DATE NEEDED: 06/16/2016	
PURPOSE AND NECESSITY: TO SERVE COMMERCIAL (ALDI) IN HOUSTON.	
RECOMMENDED BY:	DATE:
APPROVED BY:	DATE:
7945 W GRAND PKWY S HOUSTON, FORT BEND COUNTY	
CenterPoint Energy Texas Region - Houston Gas Engineering	DRAWN BY: R. DUGGAL
	DATE: 05/03/2016
	SCALE: 1"=100'
	SHEET: _____
DWG NO: EB5-16389	

- GENERAL NOTES**
1. MAINTAIN MIN. DEPTH OF 3' UNLESS OTHERWISE SPECIFIED.
 2. FIELD LOCATE AND VERIFY ALL EXISTING FEEDS, MAINS AND SERVICES.
 3. USE GAUGES TO MONITOR AND MAINTAIN FEEDS AND PRESSURE.
 4. COORDINATE SERVICE LOCATION WITH IGNACIO GUERRERO 281-341-4936