

REVIEW BY FORT BEND COUNTY COMMISSIONERS COURT

On this 5th day of July, 2016, Commissioners Court came on to be heard and reviewed the accompanying notice of CenterPoint Energy Job Location 1713 SPRING GREEN BLVD, KATY, TX 77494 Date 6/17/2016 Bond No. 22-022-417, Permit No. 2016-7843 to make use of certain Fort Bend County property subject to, "A Revised Order Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables, Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners Court of Fort Bend County, Texas the 3rd day of August, 1987, recorded in Volume _____ of the Minutes of the Commissioners Court of Fort Bend County, Texas, to the extent that such order is not inconsistent with Article 1436a, Vernon's Texas Civil Statutes. Upon Motion of Commissioner Patterson Morris, seconded by Commissioner _____, duly put and carried, it is ORDERED, ADJUDGED AND DECREED that said notice of said above purpose is hereby acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said notice be placed on record according to the regulation order thereof.

Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
 - a. 48 hours in advance of construction start up, and
 - b. when construction is completed and ready for final inspection

Mail notices to: Permit Administrator
 Fort Bend County Engineering
 301 Jackson Street
 Richmond, Texas 77469
 281-633-7500
3. This permit expires one (1) year from date of permit if construction has not commenced.


By: Charles O. Ay
 for County Engineer

Presented to Commissioners Court and approved.
 Recorded in Volume 715/116 11Q
 Minutes of Commissioners Court

By: N/A
 Drainage District Engineer/Manager

Clerk of Commissioners Court
 By: [Signature]
 Deputy

RENEE MICHULKA




PROP. 2" PLA
GAS MAIN

PROP. 2"
PLA SVC

NO SCALE

ESMTS. DED. BY: _____	ESMT. DOCUMENTS: _____
MONUMENTATION FND.: _____	PLAT DIST. CHK.=D: _____
ESMTS. NEEDED AT: _____	
NON-STD. STAKING: _____ REASON: _____	

PE 2406/2708
W.O.#78579171
TEST PRESSURE 100
GCO#:36236
NOTIFICATION#: 1403
STAKING REQUEST#: _____
PROP. 5# ZINC ANOD
PROP. TEE

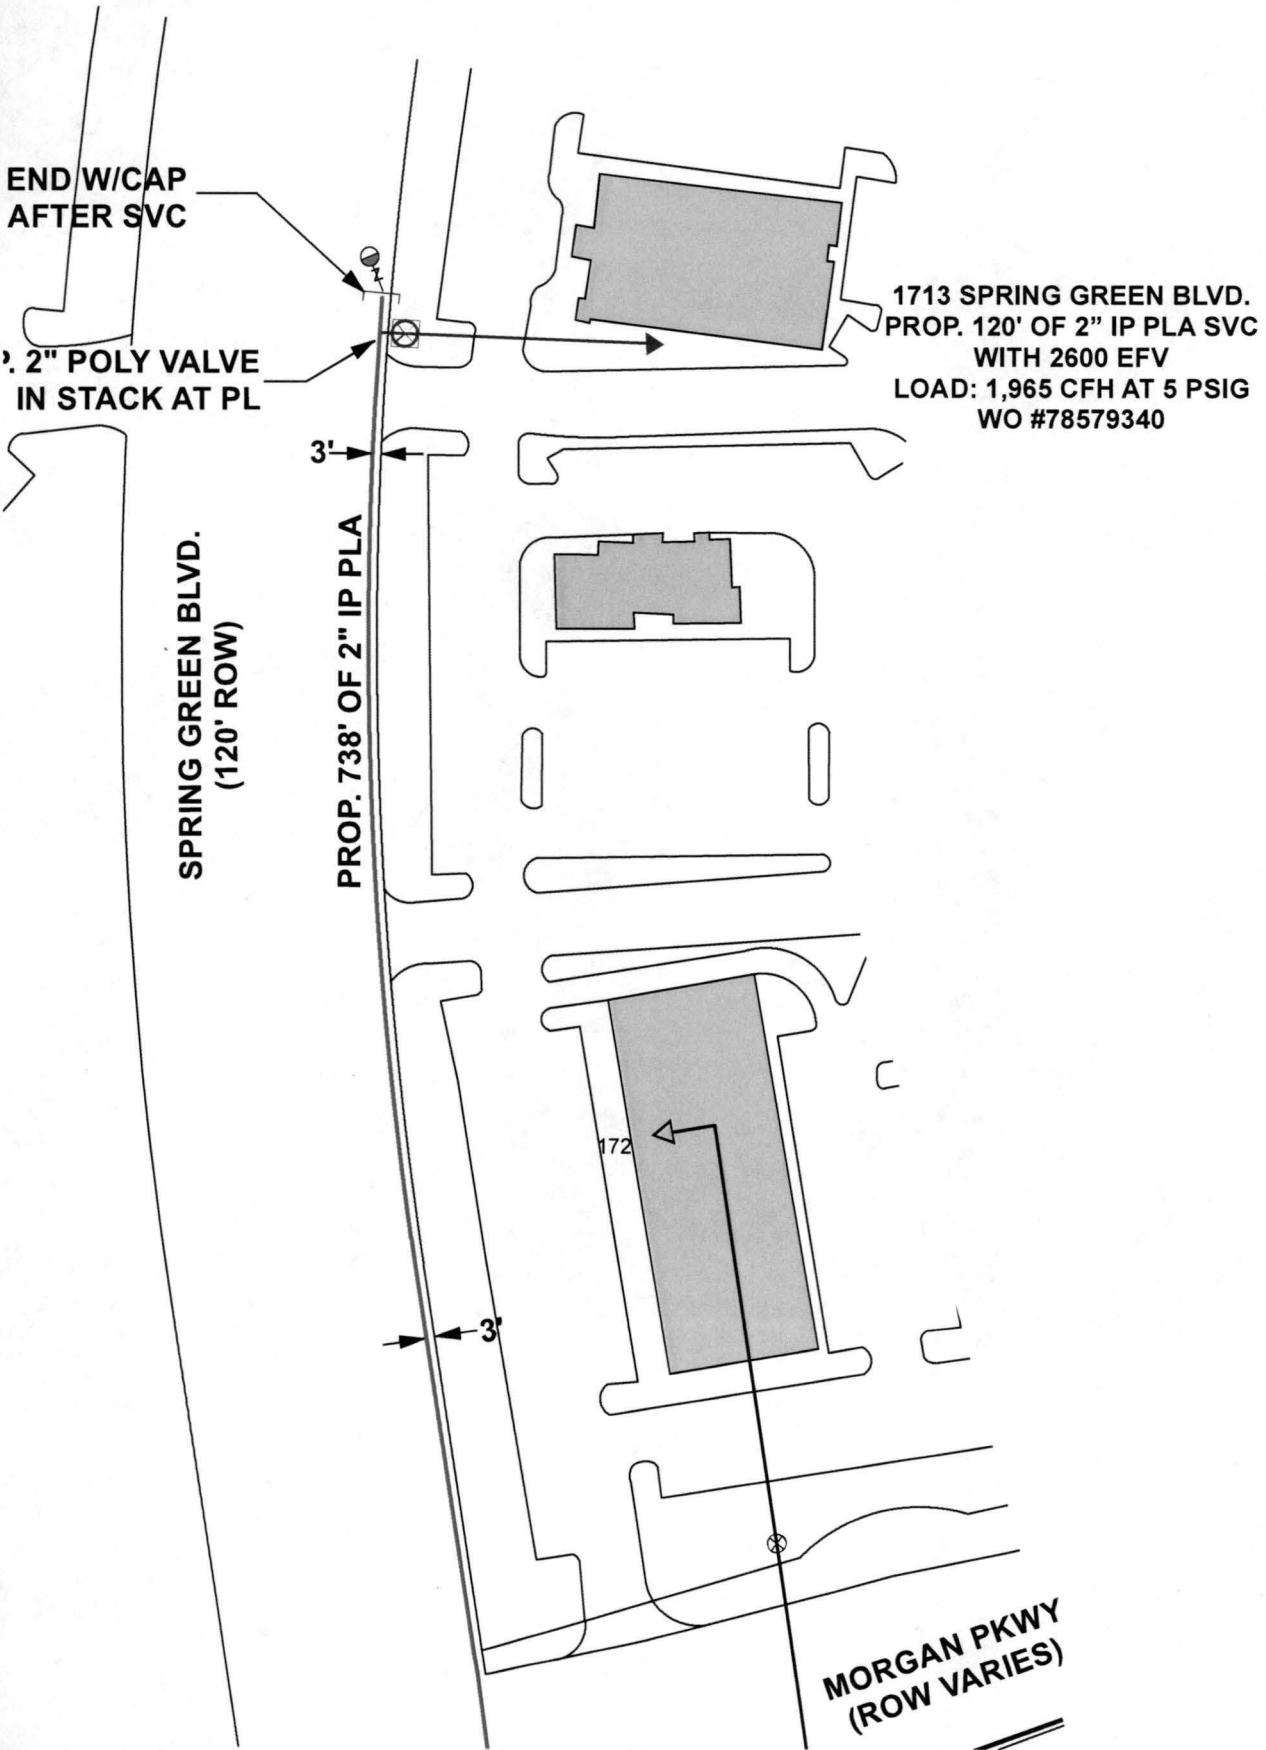

1713 SPRING GREEN BLVD.
PROP. 120' OF 2" IP PLA SVC
WITH 2600 EFV
LOAD: 1,965 CFH AT 5 PSIG
WO #78579340

SPRING GREEN BLVD.
(120' ROW)

PROP. 738' OF 2" IP PLA

MORGAN PKWY
(ROW VARIES)

GENERAL NOTES:
1- CRITERIA TO BE US
WIRE SELECTION V
PLASTIC GAS LINE:
A- USE #14 TRACER \\
RESIDENTIAL SER
B- USE #14 TRACER \\
SHORT BORES UP
OTHER NON-BORI
C- USE #10 TRACER \\
BORES LONGER T
D- USE #8 TRACER \\
FOR LARGE BAYO
AND OTHER EXTR
SITUATIONS AND \\
INSPECTOR APPR
PRIOR TO WORK.
X, Y LOC: 300196

1713 SPRING GI
KATY, FORT BE

PURPOSE:
TO SERVE FIRST CHC
FORT BEND COUNTY.
DESIGNED: PA WIMPE