



**REVIEW BY FORT BEND COUNTY
COMMISSIONERS COURT**

**Fort Bend County
Engineering Department**

301 Jackson Suite 401
Richmond, Texas 77469
281.633.7500

Permits@fortbendcountytx.gov



Right of Way Permit



Commercial Driveway Permit

Permit No: 2017-11957

Applicant: PS Light Wave, Inc

Job Location Site: Bissonnet Street, Houston, TX 77083

Bond No. **Date of Bond:** 12/13/2016 **Amount:** \$50,000.00

The above applicant came to make use of certain Fort Bend County property subject to, "The Order Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables, Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners Court of Fort Bend County, Texas, of the Minutes of the Commissioners Court of Fort Bend County, Texas, to the extent that such order is not inconsistent with Chapter 181, Vernon's Texas Statutes and Codes Annotated.

Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
 - a. 48 hours in advance of construction start up, and
 - b. When construction is completed and ready for final inspection, submit notification to Permit Administrator thru MyGovernmentOnline.org portal.
3. This permit expires one (1) year from date of permit if construction has not commenced.

On this 7th day of March, 2017, Upon Motion of Commissioner Mayers, seconded by Commissioner Patterson, duly put and carried, it is ORDERED, ADJUDGED AND DECREED that said notice of said above purpose is hereby acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said notice be placed on record according to the regulation order thereof.

Signature

Presented to Commissioners Court and approved.

By: Charles O. Ay
for County Engineer

Date Recorded 3-13-17 Comm. Court No. 12K

N/A

Clerk of Commissioners Court

By: _____
Drainage District Engineer/Manager

By: Armando Walker
Deputy



**PERMIT APPLICATION REVIEW FORM FOR
CABLE, CONDUIT, AND POLE LINE ACTIVITY
IN FORT BEND COUNTY**

**Fort Bend County
Engineering Department**
301 Jackson Suite 401
Richmond, Texas 77469
281.633.7500
Permits@fortbendcountytexas.gov

☒ Right of Way Permit
☐ Commercial Driveway Permit
Permit No: 2017-11957

The following "Notice of Proposed Cable, Conduit, and/or Pole Line activity in Fort Bend County" and accompanying attachments have been reviewed and the notice conforms to appropriate regulations set by Commissioner's Court of Fort Bend County, Texas.

(1) COMPLETE APPLICATION FORM:

- | | |
|-------------------------------------|--|
| <input checked="" type="checkbox"/> | a. Name of road, street, and/or drainage ditch affected. |
| <input checked="" type="checkbox"/> | b. Vicinity map showing course of directions |
| <input checked="" type="checkbox"/> | c. Plans and specifications |

(2) BOND:

- | | | | |
|-------------------------------------|--|---------------------|---------------------|
| <input type="checkbox"/> | County Attorney, approval when applicable. | | |
| <input checked="" type="checkbox"/> | Perpetual bond currently posted. | Bond No: [REDACTED] | Amount: \$50,000.00 |
| <input type="checkbox"/> | Performance bond submitted. | Bond No: _____ | Amount: _____ |
| <input type="checkbox"/> | Cashier's Check | Check No: _____ | Amount: _____ |

(3) DRAINAGE DISTRICT APPROVAL (WHEN APPLICABLE):

Drainage District Approval

Date


We have reviewed this project and agree it meets minimum requirements.

Charles O. Ay

Permit Administrator

2/27/17

Date

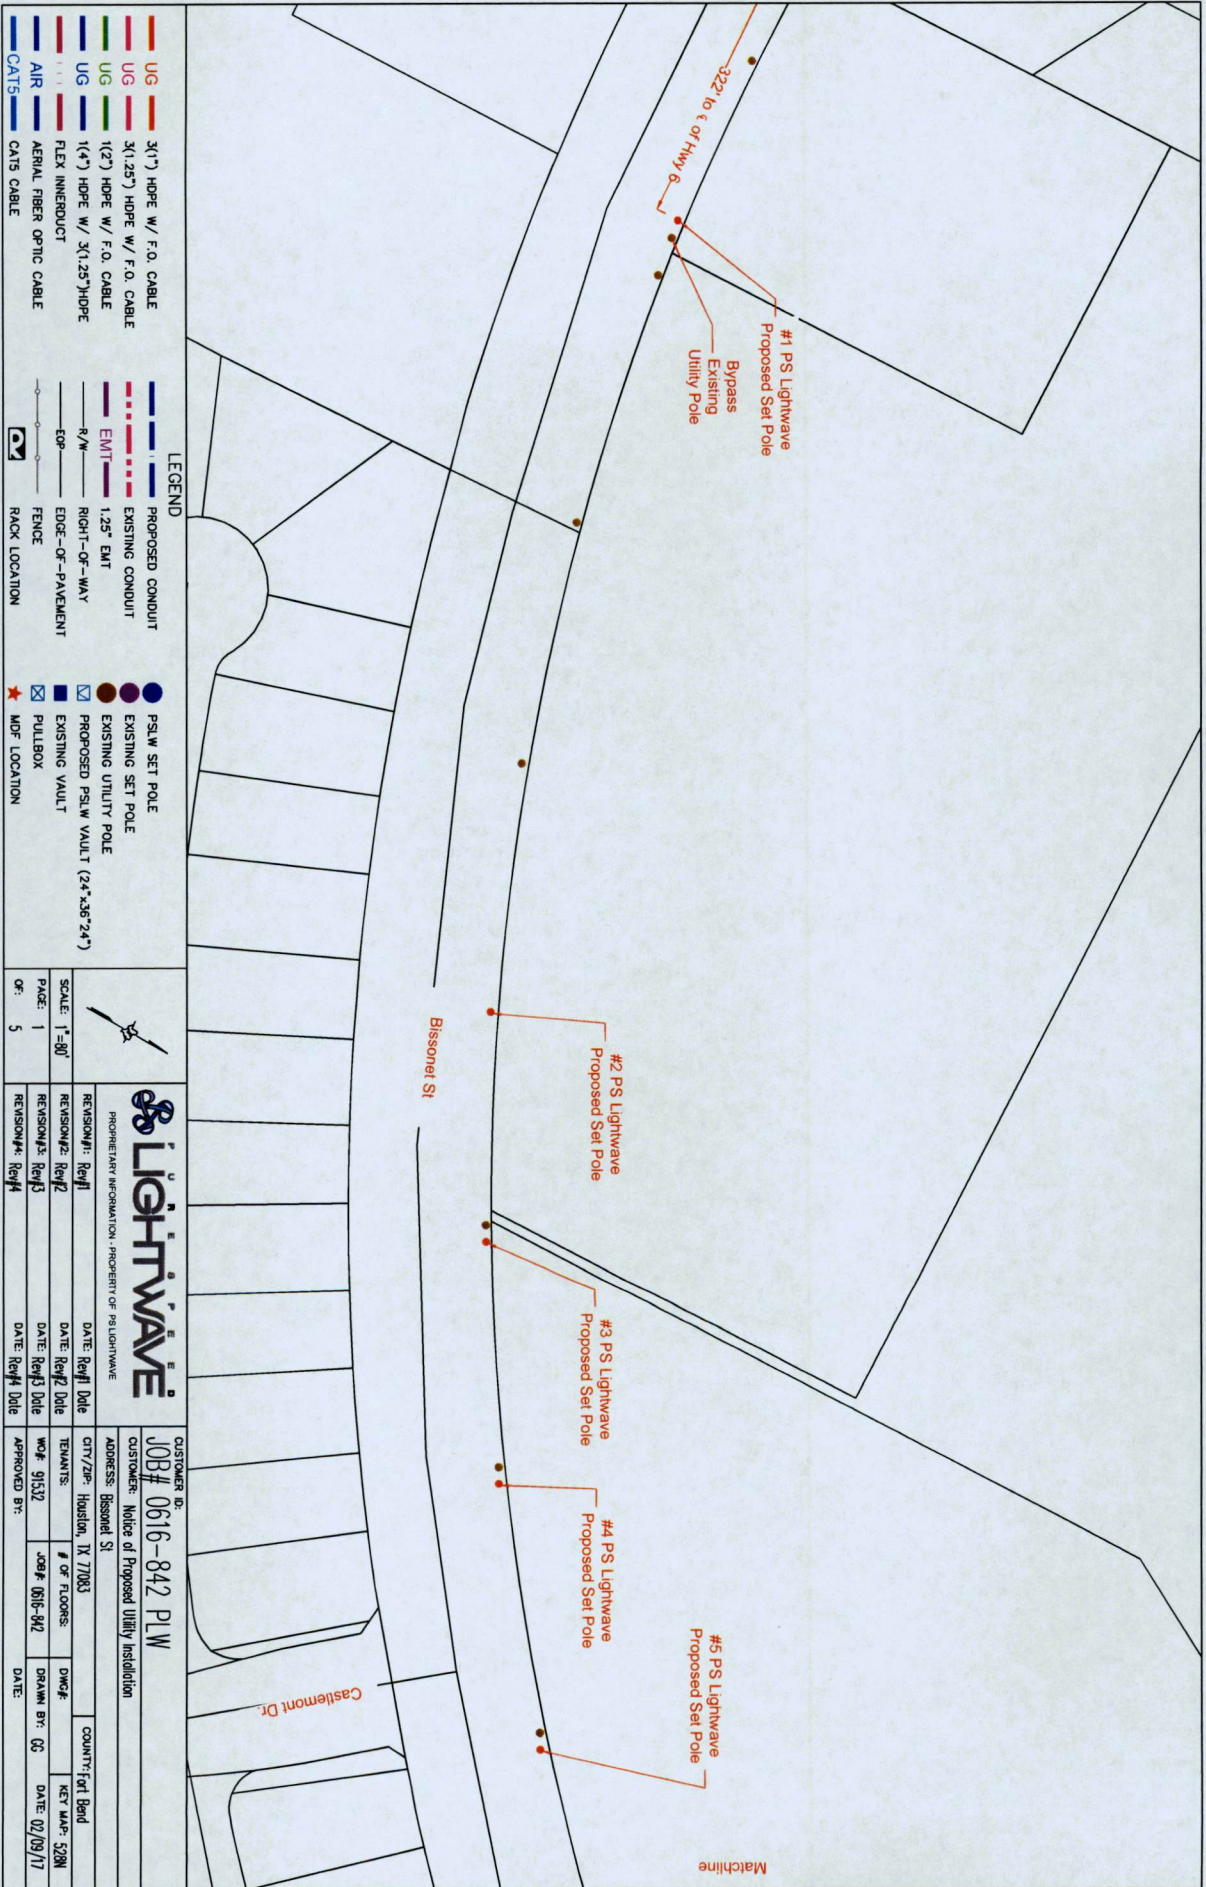

| | | | |
|------|-----------------------------|------------------|----------------------------------|
| UG | 3(1") HOPE W/ F.O. CABLE | PROPOSED CONDUIT | PSLW SET POLE |
| UG | 3(1.25") HOPE W/ F.O. CABLE | EXISTING CONDUIT | EXISTING SET POLE |
| UG | 1(2") HOPE W/ F.O. CABLE | EMT 1.25" EMT | EXISTING UTILITY POLE |
| UG | 1(4") HOPE W/ 3(1.25")HOPE | R/W | PROPOSED PSLW VAULT (24"x36"x4") |
| AIR | FLEX INNERDUCT | EOP | EXISTING VAULT |
| CATS | AERIAL FIBER OPTIC CABLE | FENCE | PULLBOX |
| CATS | CATS CABLE | RACK LOCATION | MOF LOCATION |

| | | | | | | | | | |
|---------------|--|-------------------|--|------------------|--|-----------------------------|--|-------------------|--|
| SCALE: 1"=30' | | REVISION#1: Rev#1 | | DATE: Rev#1 Date | | CITY/ZIP: Houston, TX 77063 | | COUNTY: Fort Bend | |
| PAGE: 1 | | REVISION#2: Rev#2 | | DATE: Rev#2 Date | | TELEPHONE: 915-532 | | KEY MAP: 522N | |
| OF: 5 | | REVISION#3: Rev#3 | | DATE: Rev#3 Date | | JOB#: 0616-842 | | DATE: 02/09/17 | |
| | | REVISION#4: Rev#4 | | DATE: Rev#4 Date | | APPROVED BY: | | DATE: | |

PROPRIETARY INFORMATION - PROPERTY OF LIGHTWAVE

CUSTOMER ID:

JOB# 0616-842 PLW

CUSTOMER:

Notice of Proposed Utility Installation


ADDRESS:

Bissonei St



| | | | |
|--|---|---|--------------------------|
| LEGEND | | | |
| <ul style="list-style-type: none"> UG 3x(1") HOPE W/ F.O. CABLE UG 3x(1.25") HOPE W/ F.O. CABLE UG 1(2") HOPE W/ F.O. CABLE UG 1(4") HOPE W/ 3x(1.25")HOPE UG FLEX INNERDUCT AIR AERIAL FIBER OPTIC CABLE CAT5 CAT5 CABLE | <ul style="list-style-type: none"> PROPOSED CONDUIT EXISTING CONDUIT 1.25" EMT RIGHT-OF-WAY EDGE-OF-PAVEMENT FENCE RACK LOCATION | <ul style="list-style-type: none"> PSLW SET POLE EXISTING SET POLE EXISTING UTILITY POLE PROPOSED PSLW VAULT (24"x36"x24") EXISTING VAULT PULLBOX MDF LOCATION | |
| PROPERTY INFORMATION - PROPERTY OF PS LIGHTWAVE | | | |
| REVISION#1: Rev#1 | DATE: Rev#1 Date | CITY/ZIP: Houston, TX 77083 | COUNTY: Fort Bend |
| REVISION#2: Rev#2 | DATE: Rev#2 Date | NO. OF FLOORS: 03 | KEY MAP: 5284 |
| REVISION#3: Rev#3 | DATE: Rev#3 Date | WOF#: 91532 | DATE: 02/09/17 |
| REVISION#4: Rev#4 | DATE: Rev#4 Date | APPROVED BY: | |

CUSTOMER ID: JOB# 0616-842 PLW
CUSTOMER: Notice of Proposed Utility Installation
ADDRESS: Bissonet St
DATE: 02/09/17
WOF#: 91532
APPROVED BY:

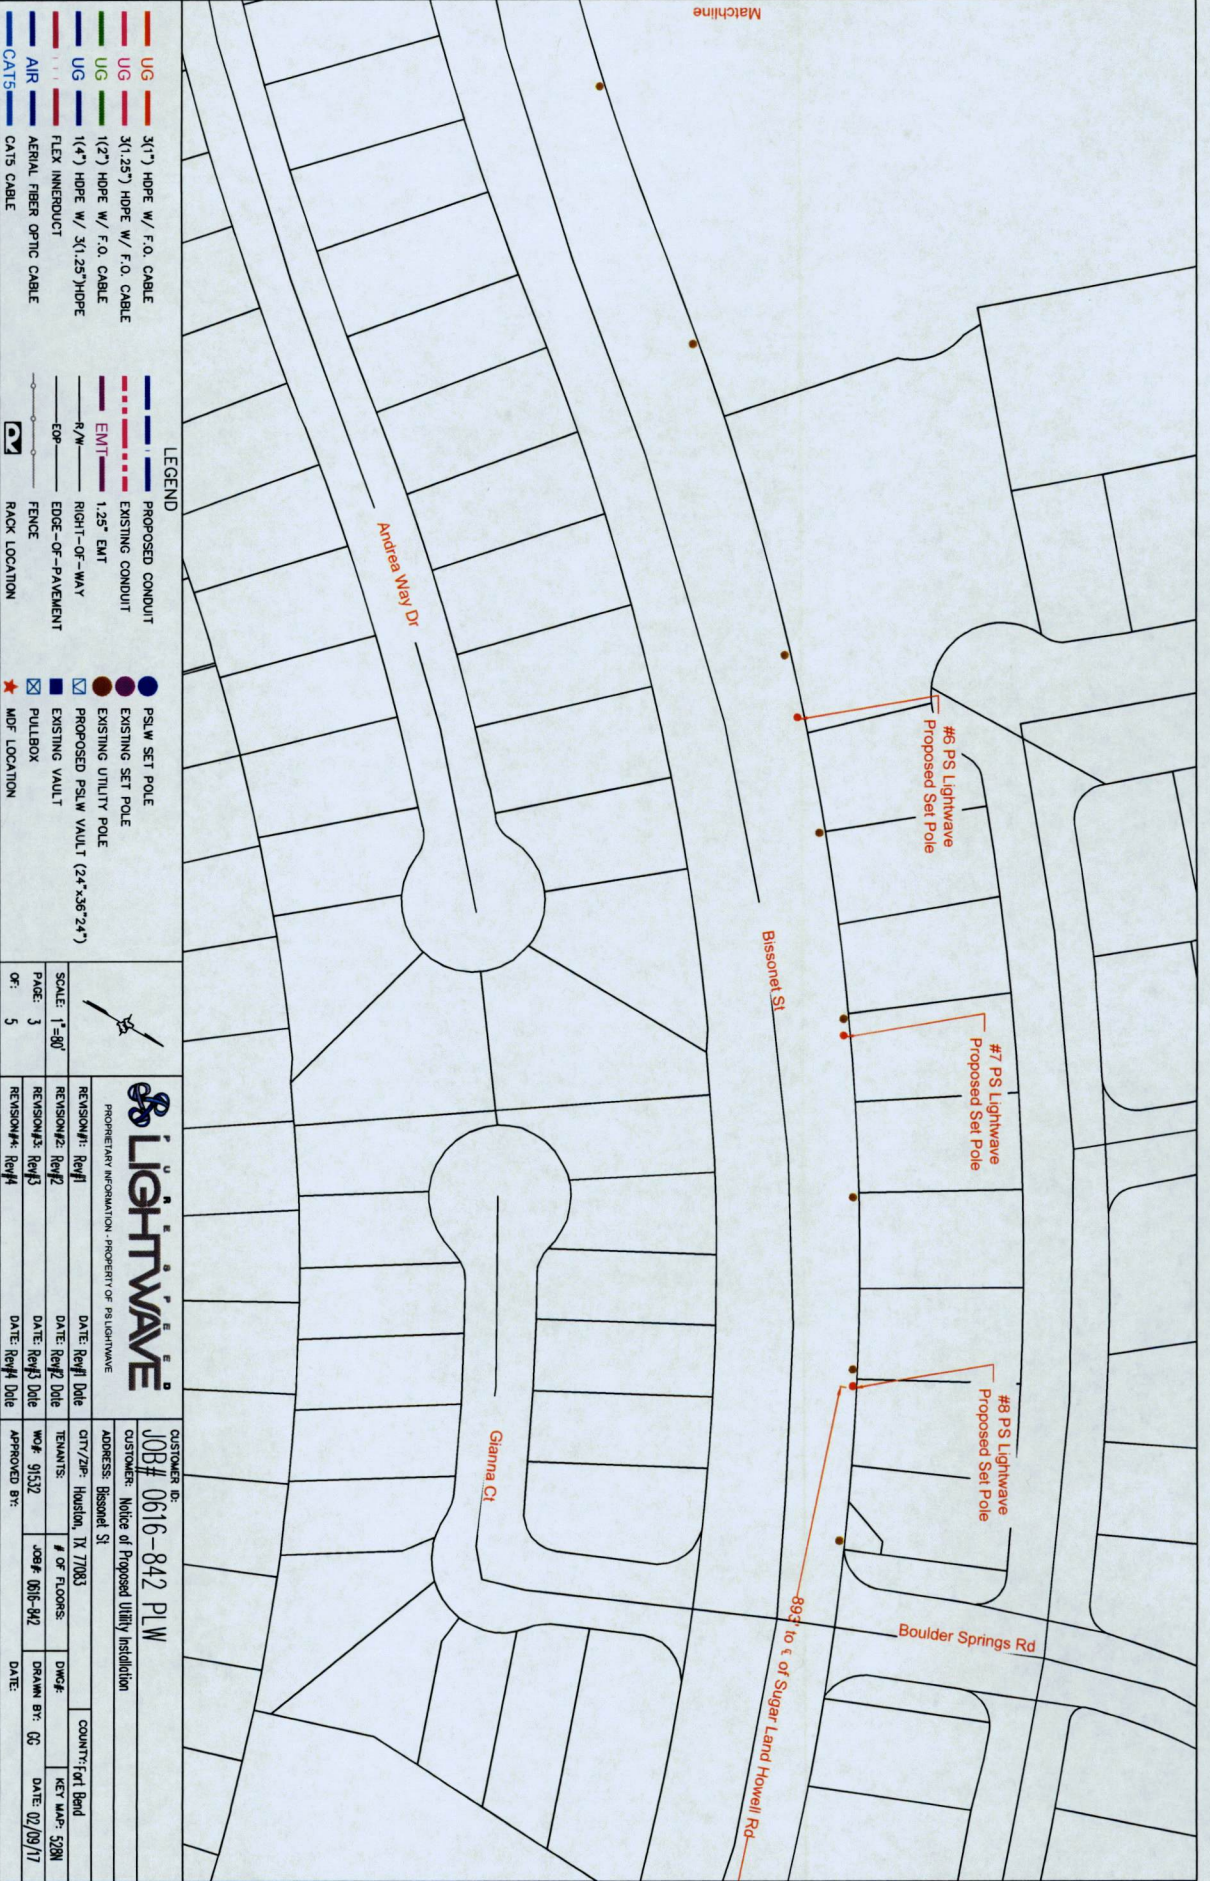



LEGEND


| | | | | | |
|------|-----------------------------|-----|------------------|---|----------------------------------|
| UG | 3(1") HOPE W/ F.O. CABLE | --- | PROPOSED CONDUIT | ● | PSLW SET POLE |
| UG | 3(1.25") HOPE W/ F.O. CABLE | --- | EXISTING CONDUIT | ● | EXISTING SET POLE |
| UG | 1(2") HOPE W/ F.O. CABLE | --- | 1.25" EMT | ● | EXISTING UTILITY POLE |
| UG | 1(4") HOPE W/ 3(1.25")HOPE | --- | R/W | ■ | PROPOSED PSLW VAULT (24"x36"x4") |
| --- | FLEX INNERDUCT | --- | EDGE-OF-WAY | ■ | EXISTING VAULT |
| AIR | AERIAL FIBER OPTIC CABLE | --- | EDGE-OF-PAVEMENT | ■ | PULLBOX |
| CATS | CATS CABLE | --- | FENCE | ★ | MDF LOCATION |
| | | --- | RACK LOCATION | | |

| | | | |
|---------------|--|---|--|
| SCALE: 1"=80' | | PS LIGHTWAVE PROPRIETARY INFORMATION - PROPERTY OF PS LIGHTWAVE | |
| PAGE: 4 | | CUSTOMER ID: JOB# 0616-842 PLW | ADDRESS: Bissont St CITY/ZIP: Houston, TX 77063 |
| OF: 5 | | REVISION#1: Rev#1 DATE: Rev#1 Date | REVISION#2: Rev#2 DATE: Rev#2 Date |
| | | REVISION#3: Rev#3 DATE: Rev#3 Date | REVISION#4: Rev#4 DATE: Rev#4 Date |

| | | | |
|--------------|---------------|--------------------|----------------|
| APPROVED BY: | DATE: | COUNTRY: Fort Bend | KEY MAP: 528N |
| WOP: 91532 | WOP: 0616-842 | DWG#: | DATE: 02/09/17 |

General Notes:

- 1) Surface to be restored to its original condition in compliance with Fort Bend County Standards.
- 2) Contractors shall provide and install traffic control devices in conformance with part VI of Texas manual on Uniform Traffic Control Devices (TMUTCD-Latest Edition with Revisions) during construction.
- 3) No Lanes shall be blocked 7am-9am and 4pm-6:30pm Monday thru Friday.

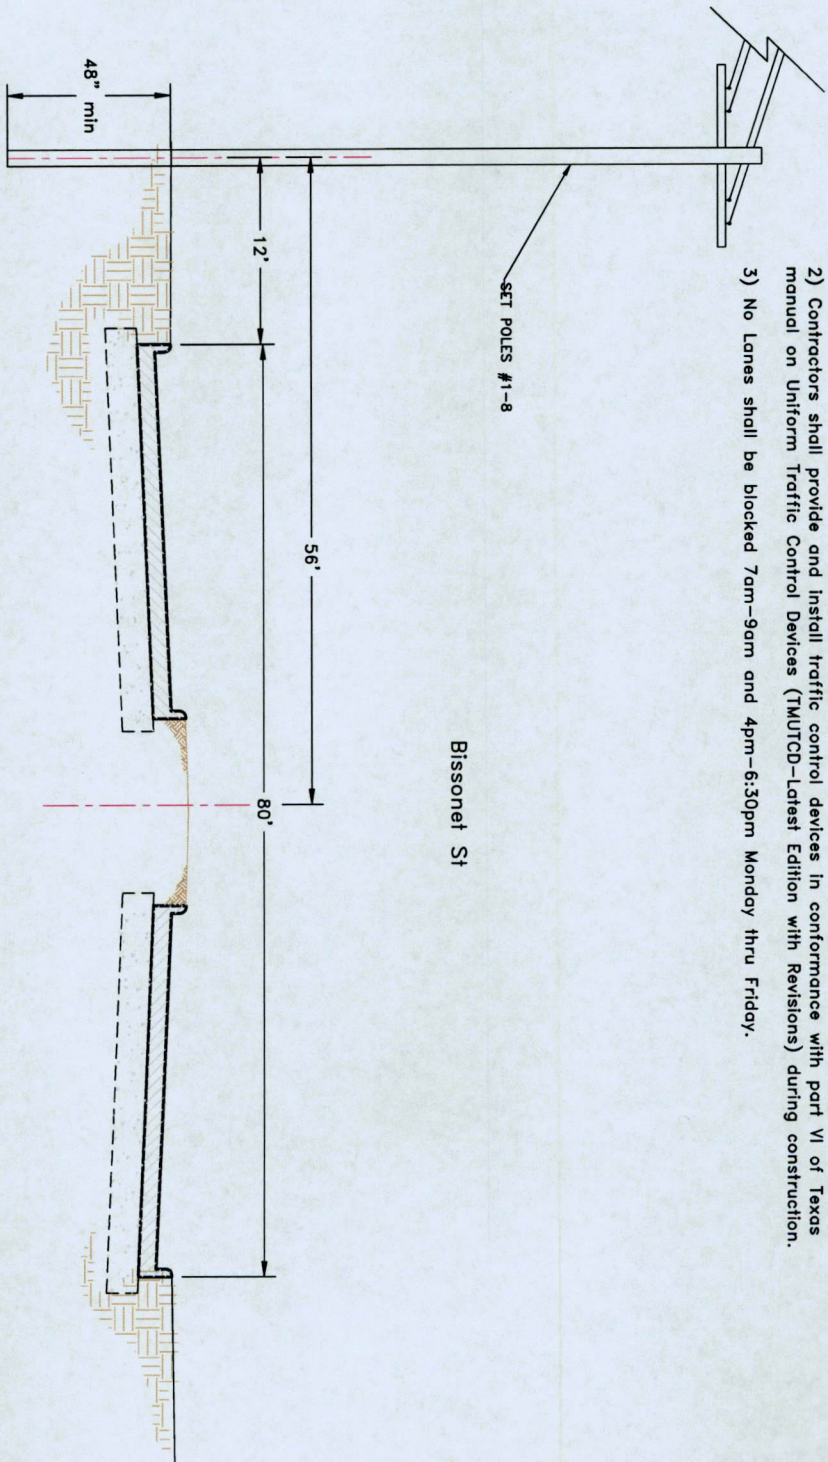

| | |
|--|-----------------------------------|
| LEGEND | |
| UG 3(1") HOPE W/ F.O. CABLE | PROPOSED CONDUIT |
| UG 3(1.25") HOPE W/ F.O. CABLE | EXISTING CONDUIT |
| UG 1(2") HOPE W/ F.O. CABLE | EMT 1.25" EMT |
| UG 1(4") HOPE W/ 3(1.25")HOPE | R/W RIGHT-OF-WAY |
| FLX FLEX INNERDUCT | EDGE-OF-PAVEMENT |
| AIR AERIAL FIBER OPTIC CABLE | FENCE |
| CATS CATS CABLE | RACK LOCATION |
| PSLW SET POLE | EXISTING SET POLE |
| EXISTING UTILITY POLE | PROPOSED PSLW VAULT (24"x36"x24") |
| EXISTING VAULT | PULL BOX |
| MDF LOCATION | |
| SCALE: N.T.S. | |
| PAGE: 5 | |
| OF: 5 | |
| REVISION#1: Rev#1 | DATE: Rev#1 Date |
| REVISION#2: Rev#2 | DATE: Rev#2 Date |
| REVISION#3: Rev#3 | DATE: Rev#3 Date |
| REVISION#4: Rev#4 | DATE: Rev#4 Date |
| Job# | Job# |
| 0616-842 PLW | 0616-842 PLW |
| Description: Notice of Proposed Utility Installation | |
| Address: Bissonnet St. | |
| City/Zip: Houston, TX 77063 | |
| TENANTS: | |
| WOF: 91532 | Job# 0616-842 |
| APPROVED BY: | DATE: |
| COUNTY: Fort Bend | |
| KEY MAP: 528H | |
| DATE: 02/09/17 | |