

**REVIEW BY FORT BEND COUNTY
COMMISSIONERS COURT**

**Fort Bend County
Engineering Department**
301 Jackson Suite 401
Richmond, Texas 77469
281.633.7500
Permits@fortbendcountytx.gov

- Right of Way Permit
 Commercial Driveway Permit

Permit No: 2018-19834

Applicant: CenterPoint Energy

Job Location Site: 8600 S Mason Road, Richmond, TX 77407

Bond No. **Date of Bond:** 4/28/1988 **Amount:** \$50,000.00

The above applicant came to make use of certain Fort Bend County property subject to, "The Order Regulating the Laying, Construction, Maintenance, and Repair of Buried Cables, Conduits, and Pole Lines, In, Under, Across or Along Roads, Streets, Highways, and Drainage Ditches in Fort Bend County, Texas, Under the Jurisdiction of the Commissioners Court of Fort Bend County, Texas," as passed by the Commissioners Court of Fort Bend County, Texas, of the Minutes of the Commissioners Court of Fort Bend County, Texas, to the extent that such order is not inconsistent with Chapter 181, Vernon's Texas Statutes and Codes Annotated.

Notes:

1. Evidence of review by the Commissioners Court must be kept on the job site and failure to do so constitutes grounds for job shutdown.
2. Written notices are required:
 - a. 48 hours in advance of construction start up, and
 - b. When construction is completed and ready for final inspection, submit notification to Permit Administrator thru MyGovernmentOnline.org portal.
3. This permit expires one (1) year from date of permit if construction has not commenced.


On this 1st day of May, 2018, Upon Motion of Commissioner Meyers, seconded by Commissioner Morales, duly put and carried, it is ORDERED, ADJUDGED AND DECREED that said notice of said above purpose is hereby acknowledged by the Commissioners Court of Fort Bend County, Texas, and that said notice be placed on record according to the regulation order thereof.

Signature
By: Rick J. Staigle, PE, PTOE
County Engineer

Presented to Commissioners Court and approved.
Date Recorded 5-7-2018 Comm. Court No. 10K

By: N/A
Drainage District Engineer/Manager

Clerk of Commissioners Court
By: Ronda Willis
Deputy



**PERMIT APPLICATION REVIEW FORM FOR
CABLE, CONDUIT, AND POLE LINE ACTIVITY
IN FORT BEND COUNTY**

**Fort Bend County
Engineering Department**
301 Jackson Suite 401
Richmond, Texas 77469
281.633.7500
Permits@fortbendcountytx.gov

- Right of Way Permit
 Commercial Driveway Permit

Permit No: 2018-19834

The following "Notice of Proposed Cable, Conduit, and/or Pole Line activity in Fort Bend County" and accompanying attachments have been reviewed and the notice conforms to appropriate regulations set by Commissioner's Court of Fort Bend County, Texas.

(1) COMPLETE APPLICATION FORM:

- a. Name of road, street, and/or drainage ditch affected.
 b. Vicinity map showing course of directions
 c. Plans and specifications

(2) BOND:

- County Attorney, approval when applicable.
- Perpetual bond currently posted. Bond No: Amount: \$50,000.00
- Performance bond submitted. Bond No: Amount:
- Cashier's Check Check No: Amount:

(3) DRAINAGE DISTRICT APPROVAL (WHEN APPLICABLE):

Drainage District Approval


Date

We have reviewed this project and agree it meets minimum requirements.


Rick J. Staigle, PE, PTOE
Permit Administrator

4/23/2018
Date

2/16/2018 7:51:38 AM O:\REVENUE_2018\SERGIO CORONA\JOINT TRENCH\1XC\FIELDSTONE_Sec 15\Drawings\Facilities_115316_PERMIT.dwg

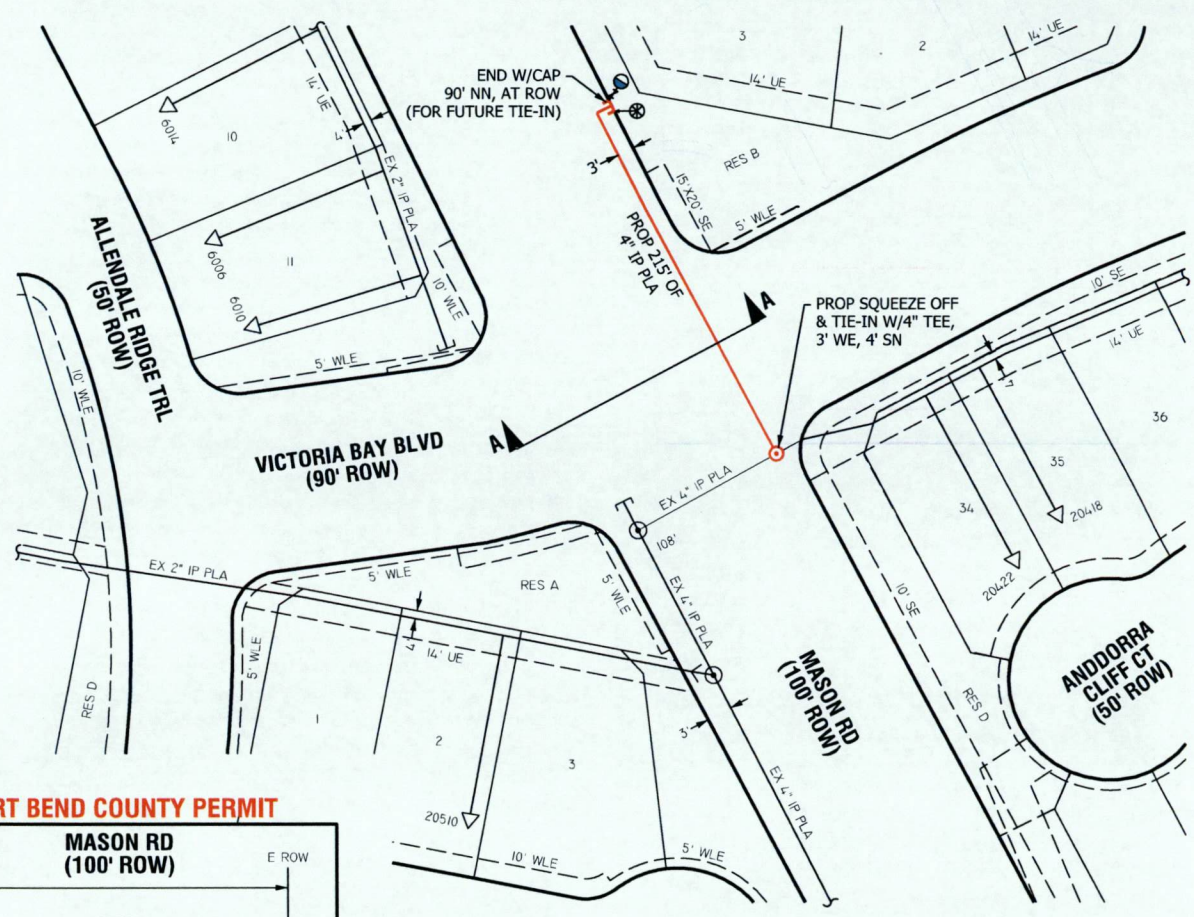

FORT BEND COUNTY PERMIT

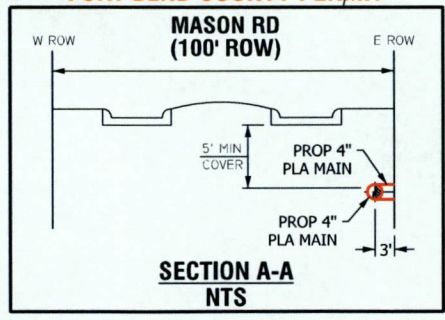

GENERAL NOTES

1. FIELD VERIFY & LOCATE ALL EXISTING FEEDS, MAINS, AND SERVICES.
2. MAINTAIN MIN DEPTH OF 3' UNLESS OTHERWISE NOTED.
3. USE GAUGES TO MONITOR & MAINTAIN FEEDS, AND PRESSURE.
4. CONTACT ENGINEERING (SERGIO CORONA AT 713-207-5862) WITH ANY NECESSARY FIELD CHANGES.
5. TEST PRESSURE @ 100 PSIG IN ACCORDANCE WITH SECTION CS-B-1.220 OF THE CONSTRUCTION & SERVICE MANUAL.

GAS STAKING

JOB NO: _____ BY: _____ DATE: _____
 ESMTS. DED. BY: _____ ESMT. DOCUMENTS: _____
 MONUMENTATION FND.: _____ PLAT DIST. CHK.=D: _____
 ESMTS. NEEDED AT: _____
 NON-STD. STAKING: _____ REASON: _____

LEGEND AND NOTES

- EXISTING MAIN** _____
- PROP 4" IP PLA MAIN **215'**
 SDR 11.5, PE 2406/2708
 WO#: 85028353
- PROP 5# ZINC ANODE
- PROP MARKER BALL
- PERMIT: HARRIS COUNTY
 GCO#: FORT BEND COUNTY
 STAKING REQUEST#: 85028353

- GENERAL NOTES:**
- CRITERIA TO BE USED FOR TRACER WIRE SELECTION WHEN INSTALLING PLASTIC GAS LINES
1. USE #14 TRACER WIRE FOR ALL RESIDENTIAL SERVICE LINES.
 2. USE #16 TRACER WIRE FOR SHORT BURES UP TO 300' AND ALL OTHER NON-BURE INSTALLATIONS.
 3. USE #10 TRACER WIRE WITH ALL BORES LONGER THAN 300'.
 4. USE #8 TRACER WIRE AS NEEDED FOR LARGE BAYOU CROSSINGS AND OTHER EXTRAORDINARY SITUATIONS AND COMPLEX BORES.
- INSPECTOR APPROVAL REQUIRED PRIOR TO WORK.

F:30330684 O:30240680 KM:526-S LAMBERT-4553A3 2:15Z S2:078 TC:N/A SOG:08850	
DESIGNED BY: SERGIO CORONA	713-207-5862
DATE NEEDED:	ESTIMATED COST: \$
START DATE:	CONTRIBUTION: \$
ESTIMATED COMPLETE DATE:	
PURPOSE AND NECESSITY: TO SERVE 03 LOTS IN TOWN NAME, COUNTY NAME	
RECOMMENDED BY:	DATE:
APPROVED BY:	DATE:

**FIELDSTONE SECTION 15
 PERMIT DRAWING
 RICHMOND, TX**

CenterPoint Energy
 Texas Region - Houston Gas Engineering

DRAWN BY: JOHN CROWELL
 DATE: 02/16/2018
 SCALE: 1:60
 SHEET: 1 OF 1
 DWG No: **EB4-18241**

